

38CKM
Export 50Hz Air Conditioner
With R-410a Refrigerant
1-1/2 To 5 Nominal Tons
Single and Three Phase



Turn to the experts

Product Data



Model 38CKM 50 Hertz energy efficient air conditioner incorporates innovative technology to provide reliable summer cooling performance. Built into these units are the features most desired by customers today, including EER ratings of up to 13 at the T1 condition when used with components designated by the manufacturer.

FEATURES AND BENEFITS

AVAILABLE SIZES:

Nominal sizes are available from 018 through 060 to meet the needs of residential and light commercial applications.

ELECTRICAL RANGE:

Units offered in single phase 230v and 240v (sizes 018-036), three phase 400v and 415v (sizes 036-060).

FAN MOTOR:

The totally enclosed ball bearing fan motor provides greater reliability under adverse conditions and dependable performance for many years. The permanent split capacitor type motor is designed for optimum efficiency. The motor is then qualified under extreme conditions to help ensure a long, reliable life.

CABINET:

A weather protective cabinet of prepainted steel is protected underneath by a galvanized coating and treated with a layer of zinc phosphate for a finish that will last for many years. All screws on cabinet exterior are coated for a long-lasting, rust-resistant, quality appearance.

UNIT DESIGN:

Aluminum fin material is pre-coated on both sides with a corrosion protective coating, capable of 1000 hr salt spray exposure per ASTM B117 test.

The copper tube, with enhanced sine wave coated aluminum fin coil, is designed for optimum heat transfer and corrosion protection. Vertical air discharge carries sound and hot condenser air up and away from adjacent patio areas and foliage. The base pan is designed for easy removal of water, dirt, and leaves.

DENSE GRILLE:

A narrow spaced coil grille is factory supplied for improved coil protection.

COMPRESSOR:

Each compressor is protected with internal temperature- and current-sensitive overloads. An internal pressure relief valve provides high pressure protection to the refrigerant system. For improved serviceability, all models are equipped with a compressor terminal plug.

FEATURES AND BENEFITS (CONT.)

SERVICE VALVES:

Both service valves are brass, front seating type with sweat connections. Valves are externally located so refrigerant tube connections can be made quickly and easily. Each valve has a service port for ease of checking operating refrigerant pressures.

SERVICEABILITY:

One access panel provides access to electrical controls. Removal of top gives access to fan motor, compressor, and condenser coil.

OPERATING RANGE:

Minimum outdoor operating ambient in cooling mode is 55°F (12.8°C), maximum is 125.6°F (52°C).

THREE PHASE MONITOR BOARD:

Control board that monitors the electrical phase and prevents reverse rotation of the compressor. Standard on all three phase units.


PRESSURE SWITCHES:

All units are equipped with high and low pressure switches.

FILTER DRIER:

Filter drier is factory supplied (field installed) for all sizes.

PRODUCT NUMBER NOMENCLATURE

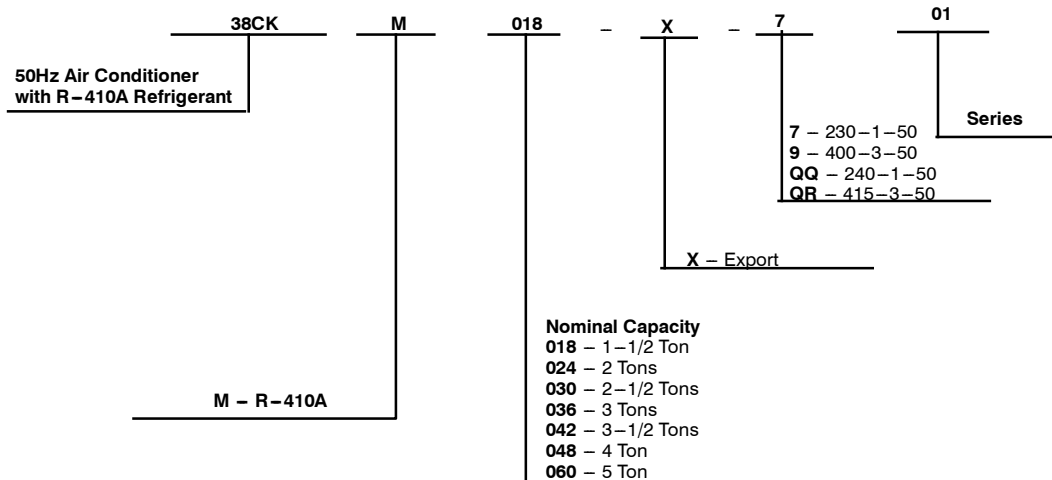

ISO 9001
QMI-SAI Global

REFRIGERANT PIPING LENGTH LIMITATIONS

Maximum Total Equivalent Length Outdoor Unit BELOW Indoor Unit

Size	Liquid Line Connection	Liquid Line Diam. w/ TXV	AC with Puron Refrigerant								
			Maximum Total Equivalent Length†: Outdoor unit BELOW Indoor Vertical Separation ft (m)								
			0-5 (0-1.5)	6-10 (1.8-3.0)	11-20 (3.4-6.1)	21-30 (6.4-9.1)	31-40 (9.4-12.2)	41-50 (12.5-15.2)	51-60 (15.5-18.3)	61-70 (18.6-21.3)	71-80 (21.6-24.4)
18	3/8	1/4	150	150	125	100	100	75	--	--	--
		5/16	250*	250*	250*	250*	250*	250*	250*	225*	150
		3/8	250*	250*	250*	250*	250*	250*	250*	250*	250*
24	3/8	1/4	75	75	75	50	50	--	--	--	--
		5/16	250*	250*	250*	250*	250*	225*	175	125	100
		3/8	250*	250*	250*	250*	250*	250*	250*	250*	250*
30	3/8	1/4	30	--	--	--	--	--	--	--	--
		5/16	175	225*	200	175	125	100	75	--	--
		3/8	250*	250*	250*	250*	250*	250*	250*	250*	250*
36	3/8	5/16	175	150	150	100	100	100	75	--	--
		3/8	250*	250*	250*	250*	250*	250*	250*	250*	250*
42	3/8	5/16	125	100	100	75	75	50	--	--	--
		3/8	250*	250*	250*	250*	250*	250*	250*	250*	150
48	3/8	3/8	250*	250*	250*	250*	250*	250*	230	160	--
60	3/8	3/8	250*	250*	250*	225*	190	150	110	--	--

* Maximum actual length not to exceed 200 ft (61 m)

† Total equivalent length accounts for losses due to elbows or fitting. See the Long Line Guideline for details.

-- = outside acceptable range

Maximum Total Equivalent Length Outdoor Unit ABOVE Indoor Unit

Size	Liquid Line Connection	Liquid Line Diam. w/ TXV	AC with Puron Refrigerant								
			Maximum Total Equivalent Length†: Outdoor unit ABOVE Indoor Vertical Separation ft (m)								
			25 (7.6)	26-50 (7.9-15.2)	51-75 (15.5-22.9)	76-100 (23.2-30.5)	101-125 (30.8-38.1)	126-150 (38.4-45.7)	151-175 (46.0-53.3)	176-200 (53.6-61.0)	
18	3/8	1/4	175	250*	250*	250*	250*	250*	250*	250*	250*
		5/16	250*	250*	250*	250*	250*	250*	250*	250*	250*
		3/8	250*	250*	250*	250*	250*	250*	250*	250*	250*
24	3/8	1/4	100	125	175	200	225*	250*	250*	250*	250*
		5/16	250*	250*	250*	250*	250*	250*	250*	250*	250*
		3/8	250*	250*	250*	250*	250*	250*	250*	250*	250*
30	3/8	1/4	30	--	--	--	--	--	--	--	--
		5/16	250*	250*	250*	250*	250*	250*	250*	250*	250*
		3/8	250*	250*	250*	250*	250*	250*	250*	250*	250*
36	3/8	5/16	225*	250*	250*	250*	250*	250*	250*	250*	250*
		3/8	250*	250*	250*	250*	250*	250*	250*	250*	250*
42	3/8	5/16	175	200	250*	250*	250*	250*	250*	250*	250*
		3/8	250*	250*	250*	250*	250*	250*	250*	250*	250*
48	3/8	3/8	250*	250*	250*	250*	250*	250*	250*	250*	250*
60	3/8	3/8	250*	250*	250*	250*	250*	250*	250*	250*	250*

* Maximum actual length not to exceed 200 ft (61 m)

† Total equivalent length accounts for losses due to elbows or fitting. See the Long Line Guideline for details.

-- = outside acceptable range

REFRIGERANT CHARGE ADJUSTMENTS

Liquid Line Size	Puron Charge oz/ft (g/m)
3/8	0.60 (17.74) (Factory charge for lineset = 9 oz / 266.16 g)
5/16	0.40 (11.83)
1/4	0.27 (7.98)

Units are factory charged for 15 ft (4.6 m) of 3/8" liquid line. The factory charge for 3/8" lineset 9 oz. When using other length or diameter liquid lines, charge adjustments are required per the chart above.

Charging Formula:

$[(\text{Lineset oz/ft} \times \text{total length}) - (\text{factory charge for lineset})] = \text{charge adjustment}$

Example 1: System has 15 ft of line set using existing 1/4" liquid line. What charge adjustment is required?

Formula: $(.27 \text{ oz/ft} \times 15\text{ft}) - (9 \text{ oz}) = (-4.95) \text{ oz.}$

Net result is to remove 4.95 oz of refrigerant from the system

Example 2: System has 45 ft of existing 5/16" liquid line. What is the charge adjustment?

Formula: $(.40 \text{ oz/ft.} \times 45\text{ft}) - (9 \text{ oz.}) = 9 \text{ oz.}$

Net result is to add 9 oz of refrigerant to the system

NOTE: Conditions must be favorable for charging by subcooling method. Indoor temperature must be 70°F to 80°F (21.1°C to 26.7°C), and outdoor temperature must be 70°F to 100°F (21.1°C to 37.8°C). If outside these conditions, adjust charge for long line sets by weigh-in method.

LONG LINE APPLICATIONS

An application is considered Long Line, when the refrigerant level in the system requires the use of accessories to maintain acceptable refrigerant management for systems reliability. See Accessory Usage Guideline table for required accessories. Defining a system as long line depends on the liquid line diameter, actual length of the tubing, and vertical separation between the indoor and outdoor units.

For Air Conditioner systems, the chart below shows when an application is considered Long Line.

AC with Puron® Refrigerant Long Line Description ft (m) Beyond these lengths, a TXV is required

Total Length	Outdoor Unit Above or Below Indoor Unit
TXV required beyond 50 ft. (15.2 m)	TXV required beyond 20 ft. (6.1 m)

AC with Puron® Refrigerant Long Line Description ft (m) (Beyond these lengths, long line accessories are required)

Liquid Line Size	Units On Same Level	Outdoor Below Indoor	Outdoor Above Indoor
1/4 + TXV	No accessories needed within allowed lengths	No accessories needed within allowed lengths	175 (53.3)
5/16 + TXV	120 (36.6)	50 (15.2) vertical or 120 (36.6) total	120 (36.6)
3/8 + TXV	80 (24.4)	35 (10.7) vertical or 80 (24.4) total	80 (24.4)

Note: See Residential Piping and Long Line Guideline for details

VAPOR LINE SIZING AND COOLING CAPACITY LOSS

Acceptable vapor line diameters provide adequate oil return to the compressor while avoiding excessive capacity loss. The suction line diameters shown in the chart below are acceptable for AC systems with Puron refrigerant:

Vapor Line Sizing and Cooling Capacity Losses — Puron® Refrigerant 1-Stage Air Conditioner Applications

Unit Nominal Size (Btuh)	Maximum Liquid Line Diameters (In. OD)	Vapor Line Diameters (In. OD)	Cooling Capacity Loss (%)								
			Total Equivalent Line Length ft. (m)								
			1-Stage AC with Puron								
			26-50 (7.9-15.2)	51-80 (15.5-24.4)	81-100 (24.7-30.5)	101-125 (30.8-38.1)	126-150 (38.4-45.7)	151-175 (46.0-53.3)	176-200 (53.6-61.0)	201-225 (61.3-68.6)	226-250 (68.9-76.2)
18	3/8	1/2	1	2	3	5	6	7	8	9	11
		5/8	0	1	1	1	2	2	2	3	3
		3/4	0	0	0	0	1	1	1	1	1
24	3/8	5/8	0	1	2	2	3	3	4	5	5
		3/4	0	0	1	1	1	1	1	2	2
		7/8	0	0	0	0	0	1	1	1	1
30	3/8	5/8	1	2	3	3	4	5	6	7	8
		3/4	0	0	1	1	1	2	2	2	3
		7/8	0	0	0	0	1	1	1	1	1
36	3/8	5/8	1	2	4	5	6	8	9	10	12
		3/4	0	1	1	2	2	3	3	4	4
		7/8	0	0	0	1	1	1	1	2	2
42	3/8	3/4	0	1	2	2	3	4	4	5	6
		7/8	0	0	1	1	1	2	2	2	3
		1 1/8	0	0	0	0	0	0	0	0	0
48	3/8	3/4	0	1	2	3	4	5	5	6	7
		7/8	0	0	1	1	2	2	2	3	3
		1 1/8	0	0	0	0	0	0	0	0	1
60	3/8	3/4	1	2	4	5	6	7	9	10	11
		7/8	0	1	2	2	3	4	4	5	5
		1 1/8	0	0	0	1	1	1	1	1	1

Applications in this area may be long line and may have height restrictions. See the Residential Piping and Long Line Guideline.

SPECIFICATIONS

UNIT SIZE	018	024	030	036	042	048	060	
40 ft HC Container Loading (Units per container)	153	153	84	84	84	84	56	
ELECTRICAL								
Unit Volts—Hertz—Phase	230–50–1 240–50–1			400–50–3 415–50–3				
Operating Voltage Range*	208–240			380–420				
PF Correction @ T3	N/A	N/A	N/A	N/A	0.902	0.923	0.904	0.901
Compressor—Rated Load Amps	9.0	10.9	13.5	16.0	7.0	8.0	9.0	11.0
Locked Rotor Amps	52.0	60.0	67.0	87.0	48.6	43.0	54.0	67.1
Condenser Fan Motor— Full Load Amps	0.52	0.52	1.2	1.2	0.56	0.56	0.65	0.65
Min Unit Ampacity for Wire Sizing	11.8	14.1	18.4	21.5	8.3	8.6	10.6	12.9
COMPRESSOR AND REFRIGERANT								
Type	Scroll							
Temperature and Current Protection	Internal Line Break							
R–410A Refrigerant— Amount Lb (kg) @ 15 ft (4.6 m)	3.73 (1.69)	4.30 (1.95)	4.67 (2.12)	5.53 (2.51)	7.46 (3.38)	8.33 (3.78)	9.41 (4.27)	
Refrigerant Tubes (In. OD) Rated Vapor and Maximum Liquid†	3/4 and 3/8			7/8 and 3/8			1–1/8 and 3/8	
CONDENSER COIL AND FAN								
Coil Face Area (Sq Ft)	9.83	11.47	12.86	15.00	15.00	15.00	17.15	
Fan Motor—HP, Type, and RPM	1/10 PSC and 940			1/4 PSC and 940				
Condenser Airflow (CFM)	2000			2500			3000	

N/A – Not applicable in this application.

* Permissible limits of the voltage range at which unit will operate satisfactorily. Operation outside these limits may result in unit failure.

† Units are rated with 15 ft (4.6 m) of lineset length. See *Vapor Line Sizing and Cooling Capacity Loss* table when using other sizes and lengths of lineset.



DIMENSIONS

UNIT	SERIES	ELECTRICAL CHARACTERISTICS					A		B		C		D		E		F		G		H		I		J		K		OPERATING WEIGHT		SHIPPING WEIGHT		SHIPPING LENGTH / WIDTH (Sq.)		SHIPPING HEIGHT										
							INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	Lbs	Kgs	Lbs	Kgs	INCH	MM	INCH	MM									
38CKM018-X-701--	0	Y	N	N	N	25	3/4	654.0	25	5/16	642.4	3/4	19.1	4	7/16	113.0	21	1/4	539.9	9	1/8	231.3	5/16	7.9	3	76.2	13	5/8	346.1	12	1/8	308.0	9	7/8	250.8	120	54.2	133	60.2	26	3/4	679.9	26	15/16	684.8
38CKM024-X-701--	0	Y	N	N	N	25	3/4	654.0	28	11/16	728.7	3/4	19.1	4	7/16	113.0	21	1/4	539.9	9	1/8	231.3	5/16	7.9	3	76.2	14	1/2	368.3	15	1/2	393.7	12	1/2	317.5	126	57.2	138	62.6	26	3/4	679.9	30	3/8	771.2
38CKM030-X-701--	0	Y	N	N	N	31	3/16	792.5	24	7/8	631.6	3/4	19.1	6	9/16	166.1	24	11/16	626.3	9	1/8	231.3	5/16	7.9	3	76.2	15	9/16	395.3	16	1/2	419.1	10	1/4	260.4	143	64.8	160	72.4	32	3/16	817.9	26	7/16	672.1
38CKM036-X-701--	0	Y	N	N	N	31	3/16	792.5	28	1/4	718.0	7/8	22.2	6	9/16	166.1	24	11/16	626.3	9	1/8	231.3	5/16	7.9	3	76.2	13	330.2	12	304.8	12	1/2	317.5	171	77.4	188	85.2	32	3/16	817.9	29	7/8	758.5		
38CKM036-X-901--	0	N	Y	N	N	31	3/16	792.5	28	1/4	718.0	7/8	22.2	6	9/16	166.1	24	11/16	626.3	9	1/8	231.3	5/16	7.9	3	76.2	13	330.2	12	304.8	12	1/2	317.5	171	77.4	188	85.2	32	3/16	817.9	29	7/8	758.5		
38CKM042-X-901--	0	N	Y	N	N	31	3/16	792.5	28	1/4	718.0	7/8	22.2	6	9/16	166.1	24	11/16	626.3	9	1/8	231.3	5/16	7.9	3	76.2	15	7/8	403.2	17	431.8	11	7/8	301.6	196	88.8	213	96.4	32	3/16	817.9	29	7/8	758.5	
38CKM048-X-901--	0	N	Y	N	N	31	3/16	792.5	28	1/4	718.0	7/8	22.2	6	9/16	166.1	24	11/16	626.3	9	1/8	231.3	5/16	7.9	3	76.2	16	3/16	411.2	16	1/4	412.8	10	1/4	260.4	196	89.0	213	96.8	32	3/16	817.9	29	7/8	758.5
38CKM060-X-901--	0	N	Y	N	N	31	3/16	792.5	31	11/16	804.3	7/8	22.2	6	9/16	166.1	24	11/16	626.3	9	1/8	231.3	5/16	7.9	3	76.2	15	1/2	393.7	16	406.4	10	7/8	276.2	215	97.4	233	105.6	32	3/16	817.9	33	1/4	844.9	

230-1-50	Y=YES
400-3-50	N=NO
240-1-50	
415-3-50	

NOTES:

1. CENTER OF GRAVITY 

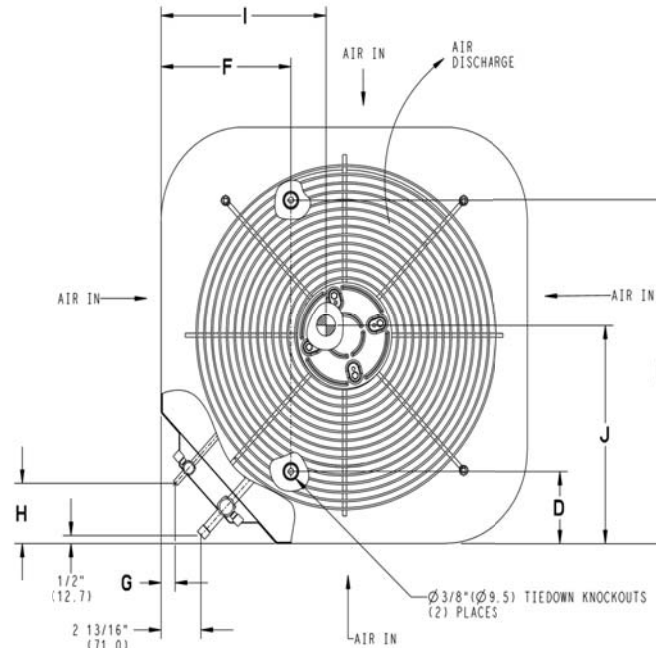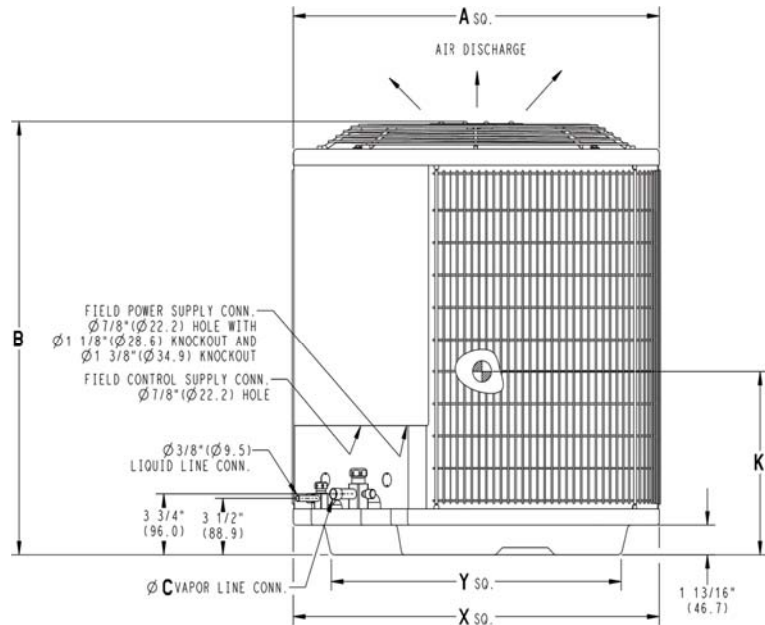

UNIT SIZE	"X" MINIMUM GROUND MOUNTING PAD APPLICATION DIMENSIONS		"Y" MINIMUM ROOF-TOP MOUNTING PAD APPLICATION DIMENSIONS	
18,24	25 3/4	654.0	20 7/16	518.5
30,36,42,48,60	31 3/16	792.5	22 15/16	583.2

NOTE: ALL DIMENSIONS IN INCH (MM)

U.S. ECCN: Not Subject to Regulation (N.S.R.)



DIMENSIONS

UNIT	SERIES	ELECTRICAL CHARACTERISTICS					A		B		C		D		E		F		G		H		I		J		K		OPERATING WEIGHT		SHIPPING WEIGHT		SHIPPING LENGTH / WIDTH (Sq.)		SHIPPING HEIGHT										
							INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	Lbs	Kgs	Lbs	Kgs	INCH	MM	INCH	MM									
38CKM018-XQQ01--	0	N	N	Y	N	25	3/4	654.0	25	5/16	642.4	3/4	19.1	4	7/16	113.0	21	1/4	539.9	9	1/8	231.3	5/16	7.9	3	76.2	13	5/8	346.1	12	1/8	308.0	9	7/8	250.8	120	54.2	133	60.2	26	3/4	679.9	26	15/16	684.8
38CKM024-XQQ01--	0	N	N	Y	N	25	3/4	654.0	28	11/16	728.7	3/4	19.1	4	7/16	113.0	21	1/4	539.9	9	1/8	231.3	5/16	7.9	3	76.2	14	1/2	368.3	15	1/2	393.7	12	1/2	317.5	126	57.2	138	62.6	26	3/4	679.9	30	3/8	771.2
38CKM030-XQQ01--	0	N	N	Y	N	31	3/16	792.5	24	7/8	631.6	3/4	19.1	6	9/16	166.1	24	11/16	626.3	9	1/8	231.3	5/16	7.9	3	76.2	15	9/16	395.3	16	1/2	419.1	10	1/4	260.4	143	64.8	160	72.4	32	3/16	817.9	26	7/16	672.1
38CKM036-XQQ01--	0	N	N	Y	N	31	3/16	792.5	28	1/4	718.0	7/8	22.2	6	9/16	166.1	24	11/16	626.3	9	1/8	231.3	5/16	7.9	3	76.2	13	330.2	12	304.8	12	1/2	317.5	171	77.4	188	85.2	32	3/16	817.9	29	7/8	758.5		
38CKM036-XQR01--	0	N	N	N	Y	31	3/16	792.5	28	1/4	718.0	7/8	22.2	6	9/16	166.1	24	11/16	626.3	9	1/8	231.3	5/16	7.9	3	76.2	13	330.2	12	304.8	12	1/2	317.5	171	77.4	188	85.2	32	3/16	817.9	29	7/8	758.5		
38CKM042-XQR01--	0	N	N	N	Y	31	3/16	792.5	28	1/4	718.0	7/8	22.2	6	9/16	166.1	24	11/16	626.3	9	1/8	231.3	5/16	7.9	3	76.2	15	7/8	403.2	17	431.8	11	7/8	301.6	196	88.8	213	96.4	32	3/16	817.9	29	7/8	758.5	
38CKM048-XQR01--	0	N	N	N	Y	31	3/16	792.5	28	1/4	718.0	7/8	22.2	6	9/16	166.1	24	11/16	626.3	9	1/8	231.3	5/16	7.9	3	76.2	16	3/16	411.2	16	1/4	412.8	10	1/4	260.4	196	89.0	213	96.8	32	3/16	817.9	29	7/8	758.5
38CKM060-XQR01--	0	N	N	N	Y	31	3/16	792.5	31	11/16	804.3	7/8	22.2	6	9/16	166.1	24	11/16	626.3	9	1/8	231.3	5/16	7.9	3	76.2	15	1/2	393.7	16	406.4	10	7/8	276.2	215	97.4	233	105.6	32	3/16	817.9	33	1/4	844.9	

200-1-50	Y=YES N=NO
400-3-50	
240-1-50	
415-3-50	

NOTES:

1. CENTER OF GRAVITY 

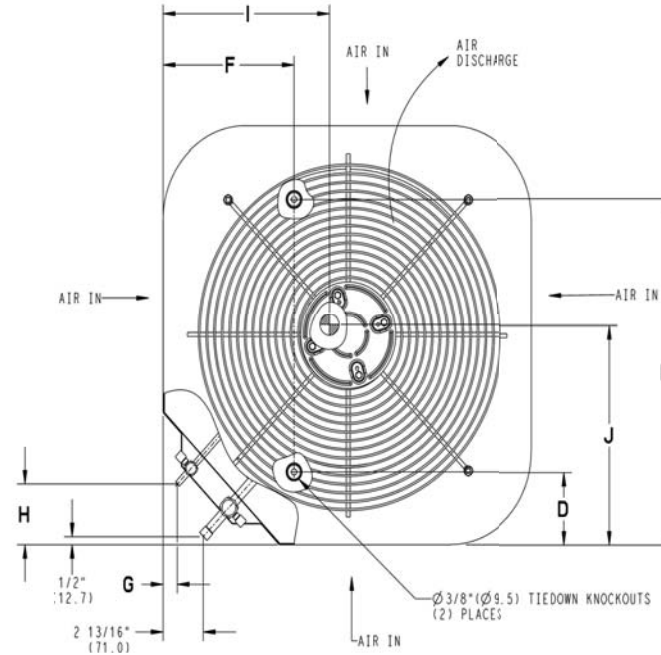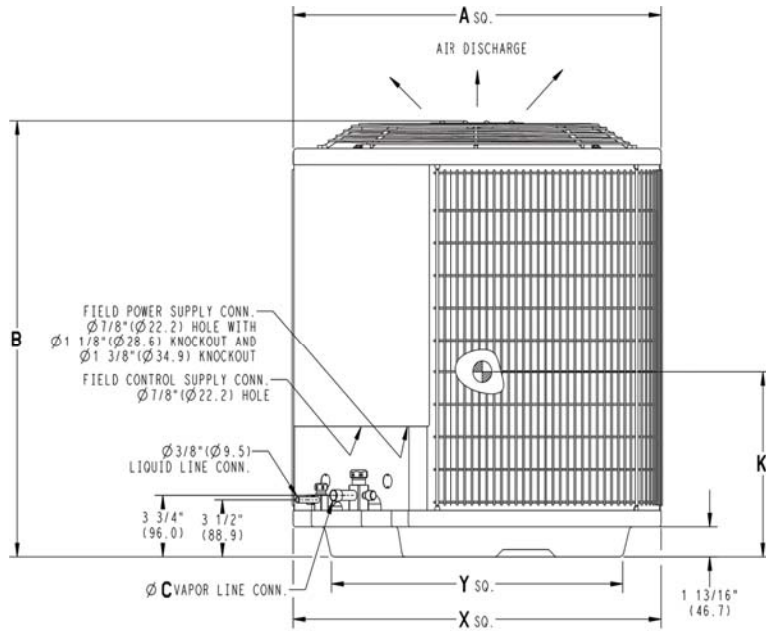


UNIT SIZE	"X"		"Y"	
	MINIMUM GROUND MOUNTING PAD APPLICATION DIMENSIONS		MINIMUM ROOF-TOP MOUNTING PAD APPLICATION DIMENSIONS	
18,24	25 3/4	654.0	20 7/16	518.5
30,36,42,48,60	31 3/16	792.5	22 15/16	583.2

NOTE: ALL DIMENSIONS IN INCH (MM)

U.S. ECCN: Not Subject to Regulation (N.S.R.)

CLEARANCES

Clearances (various examples)

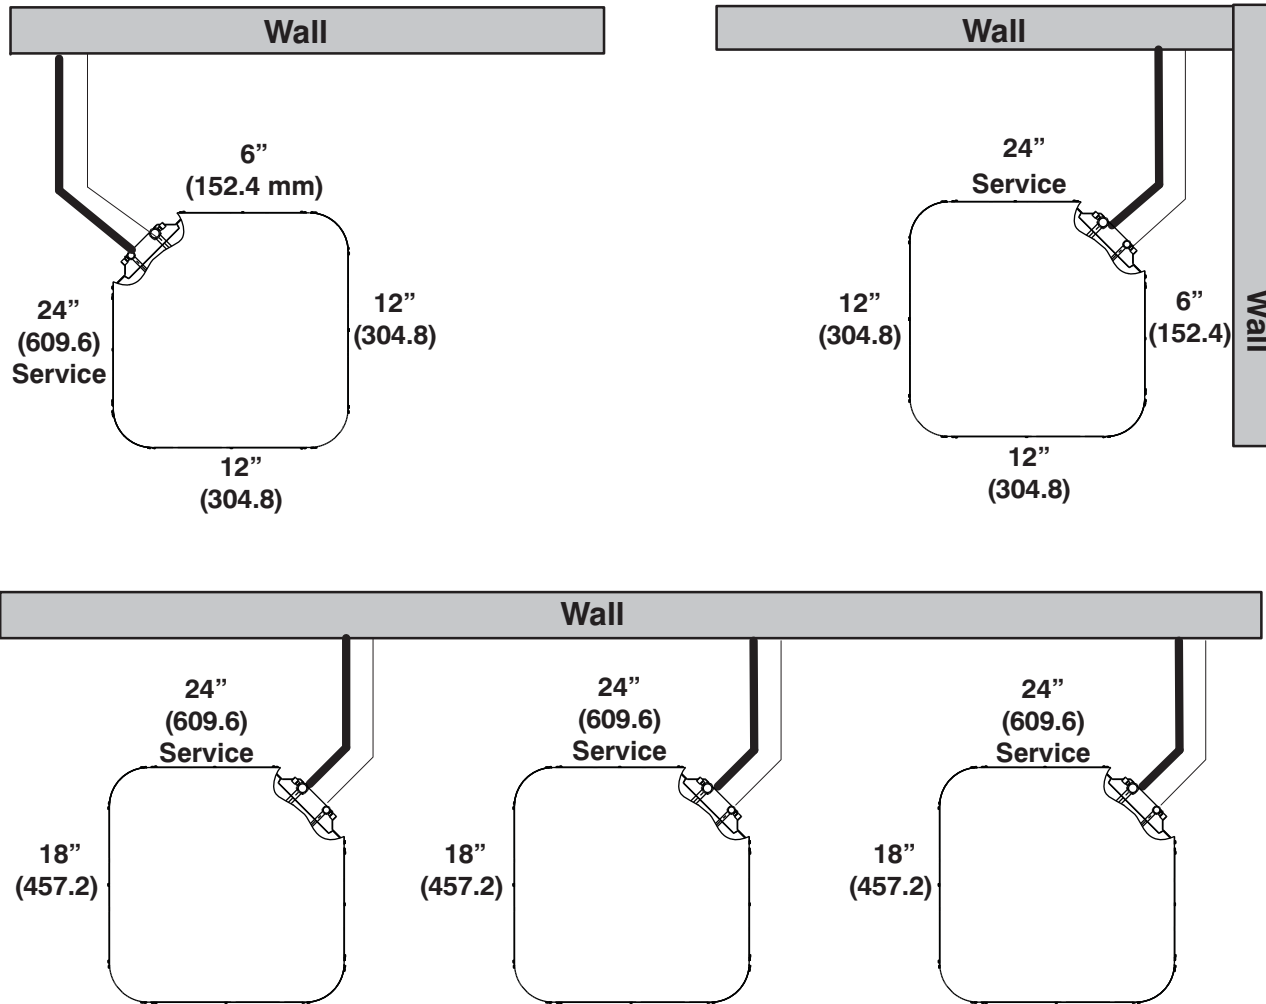

Note: Numbers in () = mm


IMPORTANT: When installing multiple units in an alcove, roof well, or partially enclosed area, ensure there is adequate ventilation to prevent re-circulation of discharge air.

A-WEIGHTED SOUND POWER (dBA)

Unit Size	Sound Level (dBA) With Sound Shield	Sound Level (dBA) W/O Sound Shield	Typical Octave Band Spectrum (dBA without tone adjustment)						
			125	250	500	1000	2000	4000	8000
018	68	69	52.0	57.5	62.0	65.0	62.0	57.5	49.5
024	69	70	52.5	62.0	62.0	64.5	62.5	59.0	53.0
030	71	72	56.5	63.0	65.0	67.0	63.0	59.5	55.0
036	73	74	55.0	62.0	65.0	69.0	66.0	59.0	55.5
042	74	75	53.5	65.0	67.5	70.0	65.5	62.5	59.0
048	76	78	57.0	66.5	69.5	73.5	68.0	64.0	57.0
060	76	78	60.5	67.5	69.0	70.5	67.0	63.0	57.0

NOTE: Tested in accordance with AHRI Standard 270-95 (not listed in AHRI).

SUBCOOLING CHART

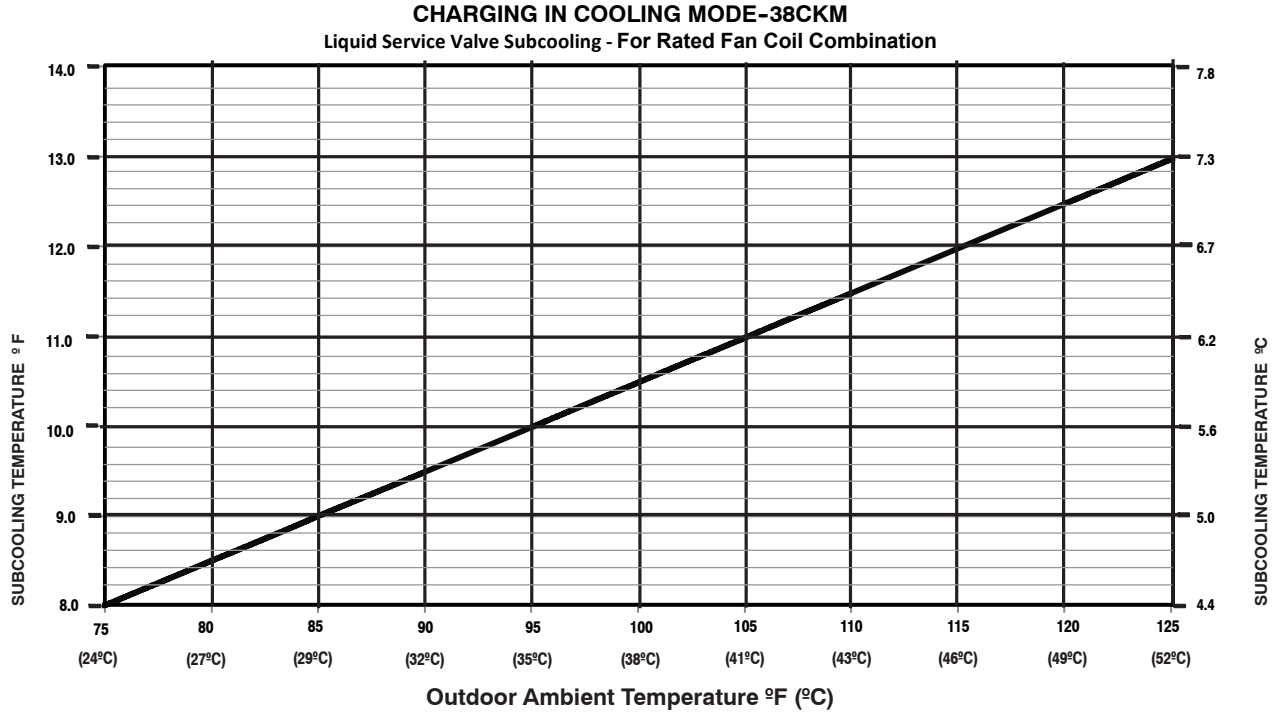

ACCESSORIES

ACCESSORY NUMBER	DESCRIPTION	Model Size							
		018-701 018-QQ	024-701 024-QQ	030-701 030-QQ	036-701 036-QQ	036-901 036-QR	042-901 042-QR	048-901 048-QR	060-901 060-QR
HC34GR231	MOTOR,FAN	X	X						
HC40GR237	MOTOR,FAN			X	X				
HC40GR403	MOTOR,FAN					X	X		
HC40GR404	MOTOR,FAN							X	X
HH07AT212	BASE,THERM/SUB	X	X	X	X	X	X	X	X
KAACF1001MED	FILTER KIT	X	X	X	X	X			
KAACF1101LRG	FILTER KIT						X	X	X
KAACH1201AAA	CRANKCASE HEATER						X	X	X
KAACH1401AAA	CRANKCASE HEATER	X	X	X	X	X			
KAACS0201PTC	KIT PTC	X	X	X	X				
KAAHI0501PUR	HIGH PRESSURE SWITCH	X	X	X	X	X	X	X	X
KAALP0401PUR	LOW PRESSURE SWITCH	X	X	X	X	X	X	X	X
KAALS0201LLS	SOLENOID VALVE KIT	X	X	X	X	X	X	X	X
KAATD0101TDR	TIME DELAY KIT	X	X	X	X	X	X	X	X
KAAWS0101AAA	WINTER START KIT	X	X	X	X	X	X	X	X
KSACY0101AAA	CYCLE PROTECTOR KIT	X	X	X	X	X	X	X	X
KSAFT0101AAA	FREEZE THERM KIT	X	X	X	X	X	X	X	X
KSAHS1501AAA	HARD START KIT	X	X	X	X				
KSALA0301410	LOW AMBIENT KIT	X	X	X	X	X	X	X	X
KSALA0601AAA	MOTORMASTER KIT	X	X	X	X				
KSALA0701AAA	MOTORMASTER KIT					X	X	X	X
KSASH0601COP	SOUND BLKT KIT				X	X	X	X	X
KSASH1801COP	SOUND BLKT KIT	X	X	X					
TSTATXXSEN01	SENSOR	X	X	X	X	X	X	X	X

X = Accessory

ACCESSORY USAGE GUIDELINE

ACCESSORY	REQUIRED FOR LOW AMBIENT COOLING APPLICATIONS (Below 55°F / 22.8°C)	REQUIRED FOR LONG LINE APPLICATIONS* (Over 80 Ft./24.4 m)	REQUIRED FOR SEA COAST APPLICATIONS (Within 2 miles/3.2 km)
Ball Bearing Fan Motor	Yes†	No	No
Compressor Start Assist Capacitor and Relay	Yes	Yes (Single-Phase Only)	No
Crankcase Heater	Yes	Yes	No
Evaporator Freeze Thermostat	Yes	No	No
TXV	Yes	Yes	Yes
Low Ambient Kit (Pressure Switch)	Yes	No	No
Support Feet	Recommended	No	Recommended
Winter Start Control	Yes‡	No	No

* For tubing line sets between 80 and 200 ft. (24.4 and 76.2 m) and/or 20 ft. (6.1 m) vertical differential, refer to Residential Split-System Longline Application Guideline.

† Required for Low Ambient Controller (full modulation feature) and MotorMaster® Control only.

‡ Required if Low Pressure Switch is factory or field installed.

ACCESSORY DESCRIPTION AND USAGE

1. Ball-Bearing Fan Motor

A fan motor with ball bearings which permits speed reduction while maintaining bearing lubrication.

Usage Guideline:

Required on all units when MotorMaster® is used.

2. Compressor Start Assist - Capacitor and Relay

Start capacitor and relay gives a "hard" boost to compressor motor at each start up.

Usage Guideline:

Required for reciprocating compressors in the following applications:

- Long line
- Low ambient cooling
- Hard shut off expansion valve on indoor coil
- Liquid line solenoid on indoor coil

Required for single-phase scroll compressors in the following applications:

- Long line
- Low ambient cooling

Suggested for all compressors in areas with a history of low voltage problems.

3. Crankcase Heater

An electric resistance heater which mounts to the base of the compressor to keep the lubricant warm during off cycles. Improves compressor lubrication on restart and minimizes the chance of liquid slugging.

Usage Guideline:

- Required in low ambient cooling applications.
- Required in long line applications.

4. Evaporator Freeze Thermostat

An SPST temperature actuated switch that stops unit operation when evaporator reaches freeze-up conditions.

Usage Guideline:

- Required when low ambient kit has been added.

5. Thermostatic Expansion Valve (XV)

A modulating flow-control valve which meters refrigerant liquid flow rate into the evaporator in response to the superheat of the refrigerant gas leaving the evaporator.

Kit includes valve, adapter tubes, and external equalizer tube.

NOTE: When using a hard shut off TXV with single phase reciprocating compressors, a Compressor Start Assist Capacitor and Relay is required.

Usage Guideline:

TXV or LLS required in air conditioner long line applications.

Required for use on all zoning systems.

6. Low Ambient Pressure Switch Kit

A long life pressure switch which is mounted to outdoor unit service valve. It is designed to cycle the outdoor fan motor in order to maintain head pressure within normal operating limits (approximately 100 psig to 225 psig). The control will maintain working head pressure at low ambient temperatures down to 0°F/-17.8°C when properly installed.

Usage Guideline:

A Low Ambient Pressure Switch or MotorMaster® Low Ambient Controller must be used when cooling operation is used at outdoor temperatures below 55°F (12.8°C).

Suggested for all commercial applications.

7. Support Feet

Four stick-on plastic feet that raise the unit 4 in. (101.6 mm) above the mounting pad. This allows sand, dirt, and other debris to be flushed from the unit base, minimizing corrosion.

Usage Guideline:

Suggested in the following applications:

- Coastal installations.
- Windy areas or where debris is normally circulating.
- Rooftop installations.
- For improved sound ratings.

8. Winter Start Control

This control is designed to alleviate nuisance opening of the low-pressure switch by bypassing it for the first 3 minutes of operation.

EQUIPMENT RATED SYSTEM MATCH AND PERFORMANCE INFORMATION

OUTDOOR PRODUCT NUMBER	INDOOR PRODUCT NUMBER	Rated Voltage/Phase/Frequency			CHARGE		TYPE	OPERATING WEIGHT OUTDOOR UNIT		COOLING CAPACITY (Btu/h)		POWER INPUT (W)		COOLING CURRENT INPUT (A)		COOLING EER (Btu/h/W)		MAX CURRENT INPUT (A)	MAX POWER INPUT (W)	POWER FACTOR (kW/kVA)
		VOLTS	Ph	Hz	lb	kg		lb	kg	T1	T3	T1	T3	T1	T3	T1	T3			
38CKM018-X-701--	FB4CSL018L00EAAA	230	1	50	3.73	1.69	R-410A	119.5	54.2	19,160	16,150	1,462	1,842	6.9	8.6	13.10	8.77	9.2	2,200	0.996
38CKM024-X-701--	FB4CSL024L00EAAA	230	1	50	4.3	1.95	R-410A	126.1	57.2	22,670	20,350	1,804	2,258	8.1	10.5	12.57	9.01	11.4	2,710	0.991
38CKM030-X-701--	FB4CSL030L00EAAA	230	1	50	4.67	2.12	R-410A	142.9	64.8	30,790	28,800	2,376	3,034	11.6	14.6	12.96	8.83	14.8	3,540	0.980
38CKM036-X-701--	FB4CSL036L00EAAA	230	1	50	5.53	2.51	R-410A	170.6	77.4	35,750	31,900	2,784	3,582	13.3	16.7	12.84	8.91	18.7	4,110	0.939
38CKM036-X-901--	FB4CSL037L00EAAA	400	3	50	5.53	2.51	R-410A	170.6	77.4	35,230	31,120	2,780	3,504	4.9	5.8	12.67	8.88	6.4	4,000	0.902
38CKM042-X-901--	FB4CSL042L00EAAA	400	3	50	7.46	3.38	R-410A	195.8	88.8	41,000	36,500	3,208	4,016	5.1	6.4	12.78	9.09	7.0	4,600	0.923
38CKM048-X-901--	FB4CSL048L00EAAA	400	3	50	8.33	3.78	R-410A	196.2	89	48,410	41,490	3,808	4,671	6.1	7.4	12.71	8.88	8.1	5,300	0.904
38CKM060-X-901--	FB4CSL060L00EAAA	400	3	50	9.41	4.27	R-410A	214.7	97.4	58,920	51,680	4,656	5,706	7.7	9.2	12.65	9.06	10.1	6,500	0.901
38CKM018-X-701--	42TPM018-7NECRE	230	1	50	4.37	1.98	R-410A	119.5	54.2	19,000	17,500	1,570	1,944	6.9	8.7	12.10	9.00	10.6	2,188	0.980
38CKM024-X-701--	42TPM024-7NECRE	230	1	50	4.70	2.13	R-410A	126.1	57.2	26,000	24,000	2,000	2,500	8.5	10.5	13.00	9.60	11.3	2,878	0.999
38CKM030-X-701--	42TPM030-7NECRE	230	1	50	6.61	3.00	R-410A	142.9	64.8	32,500	30,000	2,500	3,226	11.0	14.2	13.00	9.30	15.5	3,547	0.980
38CKM036-X-701--	42TPM036-7NECRE	230	1	50	7.50	3.40	R-410A	170.6	77.4	40,000	35,000	3,077	3,763	13.9	17.1	13.00	9.30	18.2	4,320	0.960
38CKM036-X-901--	42TPM036-7NECRE	400	3	50	7.05	3.20	R-410A	170.6	77.4	38,000	33,000	3,040	3,667	5.3	6.1	12.50	9.00	6.7	4,103	0.940
38CKM042-X-901--	42TPM042-7NECRE	400	3	50	9.92	4.50	R-410A	195.8	88.8	46,000	41,000	3,286	4,100	5.3	6.4	14.00	10.00	6.7	4,563	0.910
38CKM048-X-901--	42TPM048-7NECRE	400	3	50	8.60	3.90	R-410A	196.2	89.0	48,000	45,000	3,840	4,688	6.3	7.5	12.50	9.60	8.0	5,329	0.900
38CKM060-X-901--	42TPM060-7NECRE	400	3	50	10.58	4.80	R-410A	214.7	97.4	63,000	57,000	4,667	5,700	7.8	9.3	13.50	10.00	11.0	6,379	0.900
38CKM018-X-701--	42TKS018-71UCR1	230	1	50	3.73	1.69	R-410A	119.5	54.2	19,960	18,173	1,696	2,184	7.3	9.4	11.77	8.32	10.0	2,539	0.98
38CKM024-X-701--	42TKS024-71UCR1	230	1	50	4.30	1.95	R-410A	126.1	57.2	24,687	19,319	1,949	2,322	8.6	10.3	12.67	8.32	12.1	2,727	0.97
38CKM030-X-701--	42TKS030-71UCR1	230	1	50	6.62	3.00	R-410A	142.9	64.8	30,173	26,342	2,445	3,008	10.5	14.3	12.34	8.76	15.5	3,280	0.98
38CKM036-X-701--	42TKS036-71UCR1	230	1	50	7.50	3.40	R-410A	170.6	77.4	36,647	28,074	3,118	3,365	14.6	16.5	11.75	8.34	17.5	3,799	0.95
38CKM036-X-901--	42TKS037-71UCR1	400	3	50	7.06	3.20	R-410A	170.6	77.4	35,728	30,992	2,997	3,542	5.0	5.9	11.92	8.75	7.2	3,918	0.86
38CKM042-X-901--	42TKS042-71UCR1	400	3	50	7.45	3.38	R-410A	195.8	88.8	41,294	36,692	3,359	4,188	5.4	6.4	12.29	8.76	8.0	4,613	0.91
38CKM048-X-901--	42TKS048-71UCR1	400	3	50	8.60	3.90	R-410A	196.2	89.0	47,035	41,422	3,991	4,949	6.4	8.2	11.79	8.37	10.0	5,544	0.89
38CKM060-X-901--	42TKS060-71UCR1	400	3	50	9.42	4.27	R-410A	214.7	97.4	58,022	46,754	4,833	5,601	8.1	8.7	12.01	8.35	11.2	6,285	0.93

OUTDOOR PRODUCT NUMBER	INDOOR PRODUCT NUMBER	Rated Voltage/Phase/Frequency			REFRIGERANT CHARGE			OPERATING WEIGHT OUTDOOR UNIT	COOLING CAPACITY (Btu/h)			POWER INPUT (W)			COOLING CURRENT INPUT (A)			COOLING EER (Btu/h/W)			MAX CURRENT INPUT (A)	MAX POWER INPUT (W)		
		VOLTS	Ph	Hz	lb	kg	TYPE		lb	kg	T1	T3	T4	T1	T3	T4	T1	T3	T4	T1			T3	T4
38CKM018-XQQ01--	FB4CQL018L00EAAA	240	1	50	3.73	1.69	R-410A	119.5	54.2	19,160	16,150	15,875	1,462	1,842	1,964	6.9	8.6	9.2	13.10	8.77	8.08	9.2	2,200	
38CKM024-XQQ01--	FB4CQL024L00EAAA	240	1	50	4.3	1.95	R-410A	126.1	57.2	22,670	20,350	19,313	1,804	2,258	2,406	8.1	10.5	10.5	12.57	9.01	8.03	11.4	2,710	
38CKM030-XQQ01--	FB4CQL030L00EAAA	240	1	50	4.67	2.12	R-410A	142.9	64.8	30,790	26,800	25,550	2,376	3,034	3,168	11.6	14.6	15.1	12.96	8.83	8.07	14.8	3,540	
38CKM036-XQQ01--	FB4CQL036L00EAAA	240	1	50	5.53	2.51	R-410A	170.6	77.4	35,750	31,900	31,005	2,784	3,582	3,837	13.3	16.7	17.4	12.84	8.91	8.08	18.7	4,110	
38CKM036-XQR01--	FB4CQL037L00EAAA	415	3	50	5.53	2.51	R-410A	170.6	77.4	35,230	31,120	30,522	2,780	3,504	3,706	4.9	5.8	8.0	12.67	8.88	8.24	6.4	4,000	
38CKM042-XQR01--	FB4CQL042L00EAAA	415	3	50	7.46	3.38	R-410A	195.8	88.8	41,000	36,500	35,646	3,208	4,016	4,259	5.1	6.4	9.1	12.78	9.09	8.37	7.0	4,600	
38CKM048-XQR01--	FB4CQL048L00EAAA	415	3	50	8.33	3.78	R-410A	196.2	89	48,410	41,490	40,031	3,808	4,671	4,940	6.1	7.4	10.6	12.71	8.88	8.10	8.1	5,300	
38CKM060-XQR01--	FB4CQL060L00EAAA	415	3	50	9.41	4.27	R-410A	214.7	97.4	58,920	51,680	50,962	4,656	5,706	6,022	7.7	9.2	12.9	12.65	9.06	8.46	10.1	6,500	

Engineered in USA, assembled in Mexico

Country of Origin: Mexico

Brand: Carrier / Address: 7310 W Morris Street, Indianapolis, IN 46231

DETAILED COOLING CAPACITIES# - ENGLISH

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES ° F (° C)																	
CFM	EWB ° F (° C)	75 (23.9)			85 (29.4)			95 (35)			105 (40.6)			115 (46.1)			125 (51.7)		
		Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**
		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†	
38CKM018-X(-7,Q,Q) Outdoor Section With FB4C(S,Q)L018 Indoor Section																			
525	57 (13.9)	18.23	18.23	1.13	17.63	17.63	1.28	16.97	16.97	1.45	16.26	16.26	1.63	15.48	15.48	1.84	14.62	14.62	2.08
	62 (16.7)	19.02	16.94	1.13	18.28	16.53	1.28	17.49	16.07	1.45	16.64	15.60	1.63	15.81	15.07	1.84	14.97	14.43	2.07
	67 (19.4)	20.77	14.50	1.13	19.90	14.12	1.28	18.98	13.72	1.45	17.98	13.29	1.64	16.92	12.82	1.84	15.79	12.31	2.08
	72 (22.2)	22.79	11.94	1.13	21.81	11.57	1.29	20.77	11.17	1.46	19.67	10.74	1.65	18.51	10.29	1.86	17.27	9.80	2.09
600	57 (13.9)	19.04	19.04	1.14	18.39	18.39	1.29	17.68	17.68	1.46	16.92	16.92	1.64	16.08	16.08	1.85	15.18	15.18	2.09
	62 (16.7)	19.61	18.09	1.14	18.84	17.66	1.29	18.07	17.16	1.46	17.25	16.54	1.64	16.47	15.83	1.85	15.49	14.93	2.08
	67 (19.4)	21.26	15.44	1.14	20.34	15.05	1.30	19.37	14.63	1.46	18.35	14.19	1.65	17.26	13.71	1.86	16.09	13.20	2.09
675	72 (22.2)	23.30	12.56	1.14	22.17	12.13	1.30	21.20	11.77	1.47	20.06	11.33	1.66	18.85	10.87	1.87	17.55	10.35	2.10
	57 (13.9)	19.74	19.74	1.15	19.04	19.04	1.31	18.29	18.29	1.47	17.48	17.48	1.66	16.60	16.60	1.87	15.64	15.64	2.10
	62 (16.7)	20.16	19.11	1.15	19.41	18.57	1.30	18.66	17.96	1.47	17.78	17.17	1.65	16.63	16.63	1.87	15.67	15.67	2.10
	67 (19.4)	21.63	16.34	1.15	20.68	15.94	1.31	19.68	15.50	1.48	18.62	15.04	1.66	17.49	14.61	1.87	16.32	14.06	2.10
72 (22.2)	23.68	13.14	1.15	22.53	12.71	1.31	21.50	12.32	1.48	20.32	11.88	1.67	19.13	11.43	1.88	17.22	10.68	2.11	

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES ° F (° C)																	
CFM	EWB ° F (° C)	75 (23.9)			85 (29.4)			95 (35)			105 (40.6)			115 (46.1)			125 (51.7)		
		Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**
		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†	
38CKM024-X(-7,Q,Q) Outdoor Section With FB4C(S,Q)L024 Indoor Section																			
700	57 (13.9)	22.12	22.12	1.46	21.37	21.37	1.62	20.58	20.58	1.79	19.71	19.71	1.99	18.27	18.27	2.22	17.19	17.19	2.48
	62 (16.7)	22.81	21.02	1.46	21.91	20.54	1.61	21.09	20.04	1.79	20.08	19.29	1.99	18.68	18.04	2.22	17.30	17.19	2.48
	67 (19.4)	24.82	18.01	1.46	23.81	17.58	1.62	22.70	17.11	1.79	21.51	16.60	1.99	19.66	15.79	2.23	18.22	15.19	2.49
	72 (22.2)	27.28	14.69	1.46	26.13	14.26	1.62	24.90	13.80	1.79	23.63	13.32	2.00	22.21	12.79	2.23	20.67	12.20	2.49
800	57 (13.9)	23.00	23.00	1.48	22.21	22.21	1.64	21.37	21.37	1.82	20.43	20.43	2.02	18.94	18.94	2.25	17.78	17.78	2.51
	62 (16.7)	23.48	22.35	1.48	22.62	21.72	1.64	21.86	21.07	1.81	20.69	20.16	2.02	19.05	18.96	2.25	17.81	17.81	2.51
	67 (19.4)	25.29	19.17	1.48	24.23	18.73	1.64	23.10	18.24	1.82	21.84	17.71	2.02	19.96	16.93	2.25	18.57	16.21	2.51
	72 (22.2)	27.78	15.45	1.48	26.58	15.01	1.64	25.31	14.54	1.82	23.98	14.04	2.02	21.98	13.28	2.26	20.41	12.69	2.52
900	57 (13.9)	23.76	23.76	1.51	22.92	22.92	1.66	22.03	22.03	1.84	21.05	21.05	2.04	19.49	19.49	2.27	18.29	18.29	2.54
	62 (16.7)	24.20	23.34	1.51	23.24	22.55	1.66	22.47	21.57	1.84	21.24	20.77	2.04	19.52	19.52	2.27	18.31	18.31	2.54
	67 (19.4)	25.65	20.28	1.51	24.52	19.81	1.66	23.33	19.35	1.84	22.13	18.78	2.04	20.29	17.85	2.27	18.86	17.10	2.53
	72 (22.2)	28.17	16.18	1.51	26.93	15.73	1.66	25.62	15.24	1.84	24.26	14.73	2.04	22.23	13.97	2.28	20.61	13.34	2.54

See notes on page 20

DETAILED COOLING CAPACITIES# - ENGLISH

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES ° F (° C)																	
CFM	EWB ° F (° C)	75 (23.9)			85 (29.4)			95 (35)			105 (40.6)			115 (46.1)			125 (51.7)		
		Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**
		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†	
38CKM030-X(-7,QQ) Outdoor Section With FB4C(S,Q)L030 Indoor Section																			
875	57 (13.9)	29.27	29.27	1.84	28.13	28.13	2.06	27.08	27.08	2.32	25.90	25.90	2.60	24.63	24.63	2.93	23.24	23.24	3.31
	62 (16.7)	30.65	26.58	1.85	29.21	25.82	2.07	27.86	25.11	2.32	26.51	24.29	2.61	25.04	23.32	2.93	23.75	22.04	3.31
	67 (19.4)	33.53	22.87	1.86	31.90	22.22	2.09	30.39	21.60	2.34	28.78	20.94	2.62	27.03	20.21	2.94	25.12	19.42	3.32
	72 (22.2)	36.97	18.83	1.89	35.17	18.19	2.11	33.53	17.61	2.36	31.62	16.93	2.64	29.48	16.16	2.97	27.41	15.41	3.33
1000	57 (13.9)	30.59	30.59	1.87	29.37	29.37	2.10	28.22	28.22	2.35	26.99	26.99	2.63	25.63	25.63	2.96	24.15	24.15	3.34
	62 (16.7)	31.48	28.34	1.88	30.05	27.49	2.10	28.73	26.60	2.35	27.38	25.54	2.64	25.87	25.62	2.96	24.19	24.19	3.34
	67 (19.4)	34.28	24.36	1.89	32.57	23.68	2.12	31.01	23.04	2.37	29.34	22.36	2.65	27.50	21.64	2.97	25.60	20.82	3.34
	72 (22.2)	37.71	19.79	1.92	35.88	19.15	2.14	34.17	18.55	2.39	32.32	17.90	2.68	30.33	17.19	3.00	28.19	16.41	3.37
1125	57 (13.9)	31.71	31.71	1.90	30.42	30.42	2.13	29.21	29.21	2.38	27.91	27.91	2.67	26.48	26.48	2.99	24.92	24.92	3.37
	62 (16.7)	32.29	29.76	1.91	30.82	28.73	2.13	29.49	27.73	2.39	28.40	26.29	2.67	26.52	26.52	2.99	24.95	24.95	3.37
	67 (19.4)	34.86	25.78	1.92	33.10	25.09	2.15	31.46	24.44	2.40	29.75	23.74	2.68	27.98	22.92	3.00	26.05	21.99	3.37
	72 (22.2)	38.37	20.75	1.95	36.60	20.13	2.18	34.71	19.47	2.43	32.80	18.80	2.71	30.74	18.06	3.03	28.58	17.28	3.40

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES ° F (° C)																	
CFM	EWB ° F (° C)	75 (23.9)			85 (29.4)			95 (35)			105 (40.6)			115 (46.1)			125 (51.7)		
		Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**
		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†	
38CKM036-X(-7,QQ) Outdoor Section With FB4C(S,Q)L036 Indoor Section																			
1050	57 (13.9)	34.70	34.70	2.18	33.34	33.34	2.44	31.88	31.88	2.72	30.31	30.31	3.04	28.64	28.64	3.41	26.88	26.88	3.82
	62 (16.7)	35.95	32.27	2.19	34.32	31.41	2.44	32.69	30.35	2.72	31.00	29.16	3.05	29.35	27.69	3.41	26.89	26.89	3.82
	67 (19.4)	39.39	27.64	2.21	37.47	26.84	2.46	35.41	25.98	2.74	33.26	25.08	3.06	31.00	24.18	3.43	28.72	23.26	3.84
	72 (22.2)	43.44	22.62	2.23	41.29	21.82	2.48	39.02	20.99	2.76	36.63	20.12	3.09	34.15	19.21	3.45	31.61	18.29	3.86
1200	57 (13.9)	36.24	36.24	2.23	34.80	34.80	2.49	33.23	33.23	2.77	31.54	31.54	3.09	29.75	29.75	3.46	27.88	27.88	3.87
	62 (16.7)	37.15	34.36	2.24	35.54	33.28	2.49	33.94	31.98	2.77	32.20	30.42	3.10	29.81	29.81	3.46	27.92	27.92	3.87
	67 (19.4)	40.19	29.47	2.25	38.26	28.68	2.50	36.09	27.84	2.79	33.86	26.92	3.11	31.60	25.93	3.47	29.28	24.86	3.89
	72 (22.2)	44.36	23.85	2.27	42.13	23.04	2.53	39.77	22.19	2.81	37.30	21.31	3.13	34.73	20.39	3.50	31.57	19.25	3.90
1350	57 (13.9)	37.56	37.56	2.28	36.03	36.03	2.53	34.36	34.36	2.82	32.58	32.58	3.14	30.69	30.69	3.51	28.72	28.72	3.92
	62 (16.7)	38.29	36.02	2.28	36.75	34.56	2.54	34.72	34.41	2.82	32.65	32.65	3.14	30.73	30.73	3.51	28.76	28.76	3.92
	67 (19.4)	40.86	31.28	2.30	38.80	30.45	2.55	36.67	29.54	2.83	34.43	28.54	3.15	32.09	27.47	3.52	29.71	26.36	3.93
	72 (22.2)	45.05	25.01	2.32	42.57	24.13	2.57	40.14	23.26	2.85	37.37	22.28	3.17	34.72	21.33	3.54	32.33	20.45	3.95
38CKM036-X(-9,QR) Outdoor Section With FB4C(S,Q)L037 Indoor Section																			
1050	57 (13.9)	34.11	34.11	2.18	32.78	32.78	2.43	31.34	31.34	2.71	29.80	29.80	3.03	28.16	28.16	3.40	26.43	26.43	3.81
	62 (16.7)	35.35	31.76	2.18	33.75	30.93	2.43	32.14	29.88	2.72	30.49	28.72	3.04	28.88	27.28	3.41	26.62	26.62	3.81
	67 (19.4)	38.73	27.21	2.20	36.85	26.43	2.45	34.83	25.58	2.73	32.71	24.69	3.05	30.48	23.81	3.42	28.25	22.90	3.83
	72 (22.2)	42.71	22.27	2.22	40.60	21.49	2.47	38.37	20.67	2.75	36.02	19.81	3.08	33.20	18.78	3.44	31.08	18.00	3.85
1200	57 (13.9)	35.63	35.63	2.22	34.21	34.21	2.48	32.67	32.67	2.76	31.02	31.02	3.08	29.26	29.26	3.45	27.42	27.42	3.86
	62 (16.7)	36.53	33.83	2.23	34.94	32.76	2.48	33.38	31.49	2.76	31.28	29.65	3.08	28.95	28.95	3.45	27.46	27.46	3.86
	67 (19.4)	39.54	29.03	2.24	37.62	28.24	2.49	35.49	27.41	2.78	33.30	26.51	3.10	31.08	25.53	3.46	28.80	24.48	3.87
	72 (22.2)	43.62	23.48	2.26	41.42	22.69	2.52	39.10	21.85	2.80	36.68	20.98	3.12	34.13	20.06	3.49	31.59	19.15	3.90
1350	57 (13.9)	36.94	36.94	2.27	35.42	35.42	2.52	33.78	33.78	2.81	32.03	32.03	3.13	30.18	30.18	3.50	28.24	28.24	3.91
	62 (16.7)	37.65	35.46	2.27	36.13	34.03	2.53	34.33	32.57	2.81	32.10	32.10	3.13	30.22	30.22	3.50	28.28	28.28	3.91
	67 (19.4)	40.18	30.79	2.29	38.15	29.98	2.54	36.06	29.08	2.82	33.85	28.10	3.14	31.56	27.05	3.51	29.24	25.97	3.92
	72 (22.2)	44.30	24.62	2.31	41.92	23.77	2.56	39.57	22.93	2.85	37.05	22.03	3.17	34.61	21.18	3.53	31.96	20.24	3.94

See notes on page 20

DETAILED COOLING CAPACITIES# - ENGLISH

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES ° F (° C)																	
CFM	EWB ° F (° C)	75 (23.9)			85 (29.4)			95 (35)			105 (40.6)			115 (46.1)			125 (51.7)		
		Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**
		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†	
38CKM042-X(-9,QR) Outdoor Section With FB4C(S,Q)L042 Indoor Section																			
1225	57 (13.9)	41.15	41.15	2.55	39.47	39.47	2.84	37.44	37.44	3.17	35.50	35.50	3.54	33.44	33.44	3.97	31.30	31.30	4.45
	62 (16.7)	42.19	35.91	2.55	40.39	34.74	2.84	38.43	33.20	3.17	36.20	31.53	3.54	33.47	33.47	3.97	31.32	31.32	4.45
	67 (19.4)	45.53	30.77	2.57	43.25	29.89	2.86	40.43	28.80	3.18	38.01	27.95	3.56	35.38	26.86	3.98	32.45	25.53	4.46
	72 (22.2)	50.07	24.79	2.59	47.52	23.94	2.88	44.53	22.94	3.21	41.75	22.01	3.58	38.85	21.03	4.01	35.88	19.99	4.48
1400	57 (13.9)	42.80	42.80	2.60	41.02	41.02	2.89	38.87	38.87	3.22	36.80	36.80	3.60	34.62	34.62	4.02	32.35	32.35	4.50
	62 (16.7)	43.78	37.77	2.61	42.03	36.26	2.90	39.39	39.01	3.23	36.85	36.85	3.60	34.67	34.67	4.03	32.39	32.39	4.50
	67 (19.4)	46.37	32.92	2.62	44.02	32.03	2.91	41.31	30.94	3.24	38.75	29.85	3.61	36.09	28.70	4.04	33.41	27.47	4.51
	72 (22.2)	50.81	26.12	2.64	48.36	25.33	2.94	45.37	24.34	3.26	42.23	23.26	3.64	39.46	22.36	4.06	36.36	21.27	4.54
1575	57 (13.9)	44.22	44.22	2.66	42.32	42.32	2.95	40.06	40.06	3.28	37.89	37.89	3.65	35.60	35.60	4.08	33.22	33.22	4.56
	62 (16.7)	44.25	44.22	2.66	42.51	42.43	2.95	40.12	40.12	3.28	37.94	37.94	3.66	35.64	35.64	4.08	33.26	33.26	4.56
	67 (19.4)	47.08	34.89	2.67	44.73	33.93	2.96	41.95	32.75	3.29	39.32	31.60	3.67	36.61	30.38	4.09	33.69	28.80	4.57
	72 (22.2)	51.69	27.52	2.70	49.00	26.64	2.99	45.87	25.61	3.32	42.89	24.63	3.69	39.83	23.59	4.11	36.75	22.52	4.59

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES ° F (° C)																	
CFM	EWB ° F (° C)	75 (23.9)			85 (29.4)			95 (35)			105 (40.6)			115 (46.1)			125 (51.7)		
		Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**
		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†	
38CKM048-X(-9,QR) Outdoor Section With FB4C(S,Q)L048 Indoor Section																			
1400	57 (13.9)	47.00	47.00	3.03	45.27	45.27	3.36	43.44	43.44	3.72	41.18	41.18	4.12	38.92	38.92	4.57	36.57	36.57	5.06
	62 (16.7)	48.63	42.29	3.04	46.64	41.31	3.37	44.44	40.14	3.73	42.27	38.59	4.13	40.12	36.88	4.58	37.65	34.63	5.07
	67 (19.4)	52.70	35.84	3.06	50.40	34.90	3.39	47.90	33.87	3.76	44.92	32.60	4.15	42.00	31.34	4.60	39.04	30.01	5.09
	72 (22.2)	57.41	29.03	3.08	54.87	28.11	3.42	52.14	27.10	3.79	48.91	25.89	4.19	45.90	24.80	4.64	42.64	23.60	5.13
1600	57 (13.9)	48.89	48.89	3.09	47.07	47.07	3.42	45.12	45.12	3.78	42.72	42.72	4.18	40.31	40.31	4.63	37.82	37.82	5.12
	62 (16.7)	50.07	45.09	3.09	48.18	43.80	3.43	46.18	42.37	3.79	43.85	40.35	4.19	40.81	40.80	4.64	37.87	37.87	5.13
	67 (19.4)	53.58	38.08	3.11	51.36	37.24	3.44	48.84	36.21	3.81	45.73	34.94	4.21	42.74	33.76	4.66	39.77	32.44	5.15
	72 (22.2)	58.55	30.58	3.13	55.92	29.64	3.47	53.10	28.64	3.84	49.76	27.41	4.25	46.46	26.19	4.70	43.23	25.04	5.19
1800	57 (13.9)	50.48	50.48	3.14	48.59	48.59	3.48	46.53	46.53	3.84	44.01	44.26	4.25	41.48	41.54	4.69	38.86	38.91	5.19
	62 (16.7)	51.39	47.04	3.15	49.64	45.47	3.48	47.53	43.76	3.85	44.26	44.26	4.25	41.54	41.54	4.69	38.91	38.91	5.19
	67 (19.4)	54.51	40.40	3.16	52.05	39.44	3.50	49.46	38.46	3.87	46.41	37.18	4.27	43.42	35.81	4.71	40.37	34.37	5.20
	72 (22.2)	59.52	32.08	3.18	56.69	31.08	3.53	53.74	30.06	3.89	50.63	28.98	4.30	47.06	27.62	4.75	43.70	26.39	5.24

See notes on page 20

DETAILED COOLING CAPACITIES# - ENGLISH

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES ° F (° C)																	
		75 (23.9)			85 (29.4)			95 (35)			105 (40.6)			115 (46.1)			125 (51.7)		
		Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**	Capacity MBtuh		Total System KW**
Total	Sense†	Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†				
38CKM060-X(-9,QR) Outdoor Section With FB4C(S,Q)L060 Indoor Section																			
1600	57 (13.9)	57.19	57.19	3.61	55.21	55.21	4.04	53.10	53.10	4.53	50.85	50.85	5.08	48.44	48.44	5.69	45.86	45.86	6.38
	62 (16.7)	59.24	51.02	3.64	56.72	49.87	4.06	54.11	48.60	4.54	51.42	47.21	5.09	48.72	45.28	5.70	45.92	45.92	6.39
	67 (19.4)	64.79	43.36	3.71	61.98	42.29	4.14	59.03	41.16	4.62	55.94	40.00	5.16	52.62	38.76	5.77	49.20	37.47	6.45
	72 (22.2)	71.09	35.56	3.80	67.82	34.42	4.23	64.59	33.30	4.72	61.20	32.14	5.26	57.64	30.94	5.87	53.86	29.66	6.54
1750	57 (13.9)	58.76	58.76	3.67	56.70	56.70	4.10	54.48	54.48	4.59	52.13	52.13	5.14	49.61	49.61	5.75	46.92	46.92	6.44
	62 (16.7)	60.16	53.33	3.69	57.62	52.10	4.12	55.01	50.66	4.60	52.45	48.67	5.14	49.67	49.67	5.76	46.97	46.97	6.45
	67 (19.4)	65.66	45.20	3.76	62.76	44.12	4.19	59.72	43.00	4.67	56.49	41.79	5.21	53.16	40.54	5.82	49.63	39.23	6.50
	72 (22.2)	71.80	36.67	3.85	68.63	35.59	4.29	65.31	34.46	4.77	61.82	33.29	5.31	58.18	32.08	5.92	53.96	30.69	6.57
1900	57 (13.9)	60.17	60.17	3.73	58.01	58.01	4.16	55.70	55.70	4.65	53.26	53.26	5.19	50.64	50.64	5.81	47.84	47.84	6.50
	62 (16.7)	61.04	55.45	3.74	58.51	53.96	4.17	56.06	51.96	4.65	53.35	53.28	5.20	50.70	50.70	5.81	47.89	47.89	6.50
	67 (19.4)	66.37	46.99	3.81	63.37	45.89	4.24	60.24	44.73	4.72	57.00	43.52	5.26	53.58	42.26	5.87	50.00	40.94	6.54
	72 (22.2)	72.55	37.81	3.90	69.29	36.72	4.34	65.89	35.59	4.81	62.33	34.41	5.36	58.60	33.18	5.96	54.32	31.79	6.62
2050	57 (13.9)	61.42	61.42	3.78	59.17	59.17	4.22	56.79	56.79	4.70	54.25	54.25	5.25	51.54	51.54	5.87	48.65	48.65	6.56
	62 (16.7)	61.91	57.12	3.79	59.57	55.12	4.22	57.17	52.86	4.71	54.31	54.31	5.25	51.60	51.60	5.87	48.71	48.71	6.56
	67 (19.4)	66.91	48.70	3.86	63.88	47.59	4.29	60.73	46.42	4.77	57.41	45.20	5.31	53.95	43.93	5.92	50.30	42.59	6.59
	72 (22.2)	73.17	38.91	3.95	69.85	37.81	4.38	66.37	36.67	4.87	62.75	35.49	5.41	58.96	34.26	6.01	54.95	32.97	6.68

See notes on page 20

DETAILED COOLING CAPACITIES# - SI

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg C																	
L/S	EWB	24			29			35			41			46			52		
		Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**
		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†	
38CKM018-X(-7,QQ) Outdoor Section With FB4C(S,Q)L018 Indoor Section																			
250	14	5.34	5.34	1.13	5.17	5.17	1.28	4.97	4.97	1.45	4.76	4.76	1.63	4.53	4.53	1.84	4.28	4.28	2.08
	17	5.57	4.96	1.13	5.36	4.84	1.28	5.12	4.71	1.45	4.88	4.57	1.63	4.63	4.42	1.84	4.39	4.23	2.07
	19	6.09	4.25	1.13	5.83	4.14	1.28	5.56	4.02	1.45	5.27	3.89	1.64	4.96	3.76	1.84	4.63	3.61	2.08
285	14	5.58	5.58	1.14	5.39	5.39	1.29	5.18	5.18	1.46	4.96	4.96	1.64	4.71	4.71	1.85	4.45	4.45	2.09
	17	5.74	5.30	1.14	5.52	5.18	1.29	5.29	5.03	1.46	5.06	4.85	1.64	4.83	4.64	1.85	4.54	4.38	2.08
	19	6.23	4.52	1.14	5.96	4.41	1.30	5.67	4.29	1.46	5.38	4.16	1.65	5.06	4.02	1.86	4.71	3.87	2.09
320	14	5.78	5.78	1.15	5.58	5.58	1.31	5.36	5.36	1.47	5.12	5.12	1.66	4.86	4.86	1.87	4.58	4.58	2.10
	17	5.91	5.60	1.15	5.69	5.44	1.30	5.47	5.26	1.47	5.21	5.03	1.65	4.87	4.87	1.87	4.59	4.59	2.10
	19	6.34	4.79	1.15	6.06	4.67	1.31	5.77	4.54	1.48	5.45	4.41	1.66	5.12	4.28	1.87	4.78	4.12	2.10
	22	6.94	3.85	1.15	6.60	3.72	1.31	6.30	3.61	1.48	5.95	3.48	1.67	5.60	3.35	1.88	5.05	3.13	2.11

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg C																	
L/S	EWB ° F (° C)	24			29			35			41			46			52		
		Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**
		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†	
38CKM024-X(-7,QQ) Outdoor Section With FB4C(S,Q)L024 Indoor Section																			
330	14	6.48	6.48	1.46	6.26	6.26	1.62	6.03	6.03	1.79	5.78	5.78	1.99	5.35	5.35	2.22	5.04	5.04	2.48
	17	6.68	6.16	1.46	6.42	6.02	1.61	6.18	5.87	1.79	5.88	5.65	1.99	5.47	5.29	2.22	5.07	5.04	2.48
	19	7.27	5.28	1.46	6.98	5.15	1.62	6.65	5.01	1.79	6.30	4.86	1.99	5.76	4.63	2.23	5.34	4.45	2.49
380	14	7.99	4.30	1.46	7.66	4.18	1.62	7.30	4.04	1.79	6.92	3.90	2.00	6.51	3.75	2.23	6.06	3.58	2.49
	17	6.74	6.74	1.48	6.51	6.51	1.64	6.26	6.26	1.82	5.99	5.99	2.02	5.55	5.55	2.25	5.21	5.21	2.51
	19	6.88	6.55	1.48	6.63	6.36	1.64	6.40	6.17	1.81	6.06	5.91	2.02	5.58	5.56	2.25	5.22	5.22	2.51
425	14	7.41	5.62	1.48	7.10	5.49	1.64	6.77	5.34	1.82	6.40	5.19	2.02	5.85	4.96	2.25	5.44	4.75	2.51
	17	8.14	4.53	1.48	7.79	4.40	1.64	7.42	4.26	1.82	7.03	4.11	2.02	6.44	3.89	2.26	5.98	3.72	2.52
	19	6.96	6.96	1.51	6.71	6.71	1.66	6.45	6.45	1.84	6.17	6.17	2.04	5.71	5.71	2.27	5.36	5.36	2.54
425	17	7.09	6.84	1.51	6.81	6.61	1.66	6.58	6.32	1.84	6.22	6.09	2.04	5.72	5.72	2.27	5.36	5.36	2.54
	19	7.52	5.94	1.51	7.18	5.80	1.66	6.84	5.67	1.84	6.48	5.50	2.04	5.94	5.23	2.27	5.53	5.01	2.53
	22	8.25	4.74	1.51	7.89	4.61	1.66	7.51	4.47	1.84	7.11	4.32	2.04	6.51	4.09	2.28	6.04	3.91	2.54

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg C																	
L/S	EWB	24			29			35			41			46			52		
		Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**
		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†	
38CKM030-X(-7,QQ) Outdoor Section With FB4C(S,Q)L030 Indoor Section																			
415	14	8.57	8.57	1.84	8.24	8.24	2.06	7.93	7.93	2.32	7.59	7.59	2.60	7.22	7.22	2.93	6.81	6.81	3.31
	17	8.98	7.79	1.85	8.56	7.57	2.07	8.16	7.36	2.32	7.77	7.12	2.61	7.34	6.83	2.93	6.96	6.46	3.31
	19	9.82	6.70	1.86	9.35	6.51	2.09	8.90	6.33	2.34	8.43	6.13	2.62	7.92	5.92	2.94	7.36	5.69	3.32
470	22	10.83	5.52	1.89	10.31	5.33	2.11	9.82	5.16	2.36	9.26	4.96	2.64	8.64	4.74	2.97	8.03	4.51	3.33
	14	8.96	8.96	1.87	8.61	8.61	2.10	8.27	8.27	2.35	7.91	7.91	2.63	7.51	7.51	2.96	7.08	7.08	3.34
	17	9.22	8.30	1.88	8.81	8.05	2.10	8.42	7.79	2.35	8.02	7.48	2.64	7.58	7.51	2.96	7.09	7.09	3.34
530	19	10.04	7.14	1.89	9.54	6.94	2.12	9.09	6.75	2.37	8.60	6.55	2.65	8.06	6.34	2.97	7.50	6.10	3.34
	22	11.05	5.80	1.92	10.51	5.61	2.14	10.01	5.44	2.39	9.47	5.24	2.68	8.89	5.04	3.00	8.26	4.81	3.37
	14	9.29	9.29	1.90	8.91	8.91	2.13	8.56	8.56	2.38	8.18	8.18	2.67	7.76	7.76	2.99	7.30	7.30	3.37
530	17	9.46	8.72	1.91	9.03	8.42	2.13	8.64	8.12	2.39	8.32	7.70	2.67	7.77	7.77	2.99	7.31	7.31	3.37
	19	10.21	7.55	1.92	9.70	7.35	2.15	9.22	7.16	2.40	8.72	6.96	2.68	8.20	6.72	3.00	7.63	6.44	3.37
	22	11.24	6.08	1.95	10.72	5.90	2.18	10.17	5.70	2.43	9.61	5.51	2.71	9.01	5.29	3.03	8.37	5.06	3.40

See notes on page 20

DETAILED COOLING CAPACITIES# - SI

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg C																	
L/S	EWB	24			29			35			41			46			52		
		Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**
		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†	
38CKM036-X(-7,QQ) Outdoor Section With FB4C(S,Q)L036 Indoor Section																			
495	14	10.17	10.17	2.18	9.77	9.77	2.44	9.34	9.34	2.72	8.88	8.88	3.04	8.39	8.39	3.41	7.87	7.87	3.82
	17	10.53	9.45	2.19	10.06	9.20	2.44	9.58	8.89	2.72	9.08	8.54	3.05	8.60	8.11	3.41	7.88	7.88	3.82
	19	11.54	8.10	2.21	10.98	7.86	2.46	10.38	7.61	2.74	9.75	7.35	3.06	9.08	7.09	3.43	8.42	6.82	3.84
	22	12.73	6.63	2.23	12.10	6.39	2.48	11.43	6.15	2.76	10.73	5.90	3.09	10.01	5.63	3.45	9.26	5.36	3.86
565	14	10.62	10.62	2.23	10.20	10.20	2.49	9.74	9.74	2.77	9.24	9.24	3.09	8.72	8.72	3.46	8.17	8.17	3.87
	17	10.88	10.07	2.24	10.41	9.75	2.49	9.95	9.37	2.77	9.43	8.91	3.10	8.73	8.73	3.46	8.18	8.18	3.87
	19	11.77	8.63	2.25	11.21	8.40	2.50	10.58	8.16	2.79	9.92	7.89	3.11	9.26	7.60	3.47	8.58	7.28	3.89
	22	13.00	6.99	2.27	12.34	6.75	2.53	11.65	6.50	2.81	10.93	6.24	3.13	10.18	5.97	3.50	9.25	5.64	3.90
635	14	11.01	11.01	2.28	10.56	10.56	2.53	10.07	10.07	2.82	9.54	9.54	3.14	8.99	8.99	3.51	8.41	8.41	3.92
	17	11.22	10.55	2.28	10.77	10.13	2.54	10.17	10.08	2.82	9.57	9.57	3.14	9.00	9.00	3.51	8.43	8.43	3.92
	19	11.97	9.16	2.30	11.37	8.92	2.55	10.74	8.65	2.83	10.09	8.36	3.15	9.40	8.05	3.52	8.71	7.72	3.93
	22	13.20	7.33	2.32	12.47	7.07	2.57	11.76	6.82	2.85	10.95	6.53	3.17	10.17	6.25	3.54	9.47	5.99	3.95

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg C																	
L/S	EWB	24			29			35			41			46			52		
		Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**
		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†	
38CKM036-X(-9,QR) Outdoor Section With FB4C(S,Q)L037 Indoor Section																			
495	14	10.00	10.00	2.18	9.61	9.61	2.43	9.18	9.18	2.71	8.73	8.73	3.03	8.25	8.25	3.40	7.74	7.74	3.81
	17	10.36	9.31	2.18	9.89	9.06	2.43	9.42	8.75	2.72	8.93	8.41	3.04	8.46	7.99	3.41	7.80	7.80	3.81
	19	11.35	7.97	2.20	10.80	7.74	2.45	10.20	7.50	2.73	9.58	7.24	3.05	8.93	6.98	3.42	8.28	6.71	3.83
	22	12.51	6.52	2.22	11.90	6.30	2.47	11.24	6.05	2.75	10.55	5.80	3.08	9.73	5.50	3.44	9.11	5.28	3.85
565	14	10.44	10.44	2.22	10.02	10.02	2.48	9.57	9.57	2.76	9.09	9.09	3.08	8.57	8.57	3.45	8.03	8.03	3.86
	17	10.70	9.91	2.23	10.24	9.60	2.48	9.78	9.23	2.76	9.16	8.69	3.08	8.48	8.48	3.45	8.04	8.04	3.86
	19	11.59	8.50	2.24	11.02	8.27	2.49	10.40	8.03	2.78	9.76	7.77	3.10	9.11	7.48	3.46	8.44	7.17	3.87
	22	12.78	6.88	2.26	12.14	6.65	2.52	11.46	6.40	2.80	10.75	6.15	3.12	10.00	5.88	3.49	9.26	5.61	3.90
635	14	10.82	10.82	2.27	10.38	10.38	2.52	9.90	9.90	2.81	9.39	9.39	3.13	8.84	8.84	3.50	8.27	8.27	3.91
	17	11.03	10.39	2.27	10.59	9.97	2.53	10.06	9.54	2.81	9.40	9.40	3.13	8.85	8.85	3.50	8.29	8.29	3.91
	19	11.77	9.02	2.29	11.18	8.78	2.54	10.56	8.52	2.82	9.92	8.23	3.14	9.25	7.93	3.51	8.57	7.61	3.92
	22	12.98	7.21	2.31	12.28	6.96	2.56	11.59	6.72	2.85	10.86	6.45	3.17	10.14	6.20	3.53	9.36	5.93	3.94

See notes on page 20

DETAILED COOLING CAPACITIES# - SI

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg C																	
L/S	EWB	24			29			35			41			46			52		
		Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**
		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†	
38CKM042-X(-9,QR) Outdoor Section With FB4C(S,Q)L042 Indoor Section																			
580	14	12.06	12.06	2.55	11.56	11.56	2.84	10.97	10.97	3.17	10.40	10.40	3.54	9.80	9.80	3.97	9.17	9.17	4.45
	17	12.36	10.52	2.55	11.83	10.18	2.84	11.26	9.73	3.17	10.61	9.24	3.54	9.81	9.81	3.97	9.18	9.18	4.45
	19	13.34	9.01	2.57	12.67	8.76	2.86	11.85	8.44	3.18	11.14	8.19	3.56	10.37	7.87	3.98	9.51	7.48	4.46
	22	14.67	7.26	2.59	13.92	7.02	2.88	13.05	6.72	3.21	12.23	6.45	3.58	11.38	6.16	4.01	10.51	5.86	4.48
660	14	12.54	12.54	2.60	12.02	12.02	2.89	11.39	11.39	3.22	10.78	10.78	3.60	10.14	10.14	4.02	9.48	9.48	4.50
	17	12.83	11.07	2.61	12.31	10.63	2.90	11.54	11.43	3.23	10.80	10.80	3.60	10.16	10.16	4.03	9.49	9.49	4.50
	19	13.59	9.65	2.62	12.90	9.39	2.91	12.10	9.06	3.24	11.35	8.75	3.61	10.58	8.41	4.04	9.79	8.05	4.51
	22	14.89	7.65	2.64	14.17	7.42	2.94	13.29	7.13	3.26	12.37	6.81	3.64	11.56	6.55	4.06	10.65	6.23	4.54
745	14	12.96	12.96	2.66	12.40	12.40	2.95	11.74	11.74	3.28	11.10	11.10	3.65	10.43	10.43	4.08	9.73	9.73	4.56
	17	12.97	12.96	2.66	12.46	12.43	2.95	11.75	11.75	3.28	11.12	11.12	3.66	10.44	10.44	4.08	9.75	9.75	4.56
	19	13.79	10.22	2.67	13.11	9.94	2.96	12.29	9.60	3.29	11.52	9.26	3.67	10.73	8.90	4.09	9.87	8.44	4.57
	22	15.14	8.06	2.70	14.36	7.80	2.99	13.44	7.50	3.32	12.57	7.22	3.69	11.67	6.91	4.11	10.77	6.60	4.59

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg C																	
L/S	EWB	24			29			35			41			46			52		
		Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**
		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†	
38CKM048-X(-9,QR) Outdoor Section With FB4C(S,Q)L048 Indoor Section																			
660	14	13.77	13.77	3.03	13.26	13.26	3.36	12.73	12.73	3.72	12.07	12.07	4.12	11.40	11.40	4.57	10.72	10.72	5.06
	17	14.25	12.39	3.04	13.66	12.11	3.37	13.02	11.76	3.73	12.39	11.31	4.13	11.76	10.81	4.58	11.03	10.15	5.07
	19	15.44	10.50	3.06	14.77	10.23	3.39	14.03	9.92	3.76	13.16	9.55	4.15	12.31	9.18	4.60	11.44	8.79	5.09
	22	16.82	8.51	3.08	16.08	8.23	3.42	15.28	7.94	3.79	14.33	7.58	4.19	13.45	7.27	4.64	12.49	6.91	5.13
755	14	14.32	14.32	3.09	13.79	13.79	3.42	13.22	13.22	3.78	12.52	12.52	4.18	11.81	11.81	4.63	11.08	11.08	5.12
	17	14.67	13.21	3.09	14.12	12.83	3.43	13.53	12.42	3.79	12.85	11.82	4.19	11.96	11.95	4.64	11.10	11.10	5.13
	19	15.70	11.16	3.11	15.05	10.91	3.44	14.31	10.61	3.81	13.40	10.24	4.21	12.52	9.89	4.66	11.65	9.50	5.15
	22	17.16	8.96	3.13	16.38	8.69	3.47	15.56	8.39	3.84	14.58	8.03	4.25	13.61	7.67	4.70	12.67	7.34	5.19
850	14	14.79	14.79	3.14	14.24	14.24	3.48	13.63	13.63	3.84	12.89	12.89	4.25	12.15	12.15	4.69	11.39	11.39	5.19
	17	15.06	13.78	3.15	14.55	13.32	3.48	13.92	12.82	3.85	12.97	12.97	4.25	12.17	12.17	4.69	11.40	11.40	5.19
	19	15.97	11.84	3.16	15.25	11.56	3.50	14.49	11.27	3.87	13.60	10.89	4.27	12.72	10.49	4.71	11.83	10.07	5.20
	22	17.44	9.40	3.18	16.61	9.11	3.53	15.74	8.81	3.89	14.84	8.49	4.30	13.79	8.09	4.75	12.80	7.73	5.24

See notes on page 20

DETAILED COOLING CAPACITIES# - SI

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg C																	
		24			29			35			41			46			52		
L/S	EWB	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**	Capacity kW		Total System KW**
		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†		Total	Sense†	
38CKM060-X(-9,QR) Outdoor Section With FB4C(S,Q)L060 Indoor Section																			
755	14	16.76	16.76	3.61	16.18	16.18	4.04	15.56	15.56	4.53	14.90	14.90	5.08	14.19	14.19	5.69	13.44	13.44	6.38
	17	17.36	14.95	3.64	16.62	14.61	4.06	15.85	14.24	4.54	15.07	13.83	5.09	14.27	13.27	5.70	13.45	13.45	6.39
	19	18.98	12.70	3.71	18.16	12.39	4.14	17.30	12.06	4.62	16.39	11.72	5.16	15.42	11.36	5.77	14.41	10.98	6.45
	22	20.83	10.42	3.80	19.87	10.08	4.23	18.93	9.76	4.72	17.93	9.42	5.26	16.89	9.06	5.87	15.78	8.69	6.54
625	14	17.22	17.22	3.67	16.61	16.61	4.10	15.96	15.96	4.59	15.27	15.27	5.14	14.54	14.54	5.75	13.75	13.75	6.44
	17	17.63	15.63	3.69	16.88	15.26	4.12	16.12	14.84	4.60	15.37	14.26	5.14	14.55	14.55	5.76	13.76	13.76	6.45
	19	19.24	13.24	3.76	18.39	12.93	4.19	17.50	12.60	4.67	16.55	12.24	5.21	15.58	11.88	5.82	14.54	11.49	6.50
	22	21.04	10.74	3.85	20.11	10.43	4.29	19.13	10.10	4.77	18.11	9.75	5.31	17.05	9.40	5.92	15.81	8.99	6.57
895	14	17.63	17.63	3.73	17.00	17.00	4.16	16.32	16.32	4.65	15.60	15.60	5.19	14.84	14.84	5.81	14.02	14.02	6.50
	17	17.88	16.25	3.74	17.14	15.81	4.17	16.43	15.22	4.65	15.63	15.61	5.20	14.85	14.85	5.81	14.03	14.03	6.50
	19	19.45	13.77	3.81	18.57	13.45	4.24	17.65	13.11	4.72	16.70	12.75	5.26	15.70	12.38	5.87	14.65	12.00	6.54
	22	21.26	11.08	3.90	20.30	10.76	4.34	19.31	10.43	4.81	18.26	10.08	5.36	17.17	9.72	5.96	15.92	9.31	6.62
965	14	17.99	17.99	3.78	17.34	17.34	4.22	16.64	16.64	4.70	15.89	15.89	5.25	15.10	15.10	5.87	14.26	14.26	6.56
	17	18.14	16.74	3.79	17.45	16.15	4.22	16.75	15.49	4.71	15.91	15.91	5.25	15.12	15.12	5.87	14.27	14.27	6.56
	19	19.61	14.27	3.86	18.72	13.94	4.29	17.79	13.60	4.77	16.82	13.24	5.31	15.81	12.87	5.92	14.74	12.48	6.59
	22	21.44	11.40	3.95	20.47	11.08	4.38	19.45	10.74	4.87	18.38	10.40	5.41	17.27	10.04	6.01	16.10	9.66	6.68

NOTE: When the required data falls between the published data, interpolation may be performed. Extrapolation is not an acceptable practice.

Detailed cooling capacities are based on indoor and outdoor unit at the same elevation. If additional tubing length and/or indoor unit is located above outdoor unit, a slight variation in capacity may occur.

† Total and sensible capacities are net capacities. Blower motor heat has been subtracted.

‡ Sensible capacities shown are based on 80° F (27° C) entering air at the indoor coil. For sensible capacities at other than 80° F (27° C), deduct 835 Btuh (245 W) per 1000 CFM (480 L/S) of indoor coil air for each degree below 80° F (27° C), or add 835 Btuh (245 W) per 1000 CFM (480 L/S) of indoor coil air per degree above 80° F (27° C).

** System kw is total of indoor and outdoor unit power.

EWB – Entering Wet Bulb

L/S – Liters Per Second

CONDENSER ONLY RATINGS - ENGLISH

SST °F (°C)		CONDENSER ENTERING AIR TEMPERATURES °F (°C)							
		55 (12.8)	65 (18.3)	75 (23.9)	85 (29.4)	95 (35)	105 (40.6)	115 (46.1)	125 (51.7)
38CKM018-X(-7,QQ)									
30 (-1.1)	TCG	17.50	16.80	16.00	14.60	13.70	12.80	11.80	10.70
	SDT	65.30	75.00	84.70	94.30	103.90	113.50	123.10	132.70
	KW	0.79	0.92	1.06	1.20	1.36	1.53	1.74	1.99
35 (1.7)	TCG	19.50	18.60	17.80	16.20	15.30	14.20	13.10	12.00
	SDT	66.30	76.00	85.60	95.20	104.80	114.30	123.90	133.40
	KW	0.78	0.92	1.05	1.20	1.36	1.54	1.74	1.99
40 (4.4)	TCG	21.60	20.60	19.60	18.00	16.90	15.80	14.60	13.40
	SDT	67.30	77.00	86.60	96.10	105.60	115.20	124.70	134.20
	KW	0.76	0.91	1.05	1.20	1.36	1.54	1.75	1.99
45 (7.2)	TCG	23.80	22.70	21.60	19.80	18.60	17.40	16.10	14.80
	SDT	68.40	78.00	87.60	97.10	106.60	116.00	125.50	134.90
	KW	0.75	0.90	1.05	1.20	1.37	1.55	1.76	1.99
50 (10)	TCG	26.20	24.90	23.60	21.80	20.40	19.10	17.70	16.30
	SDT	69.60	79.20	88.70	98.10	107.50	116.90	126.30	135.60
	KW	0.74	0.90	1.05	1.21	1.38	1.56	1.76	2.00
55 (12.8)	TCG	28.60	27.20	25.80	23.80	22.30	20.90	19.40	17.80
	SDT	70.80	80.30	89.80	99.10	108.50	117.80	127.10	136.40
	KW	0.74	0.90	1.06	1.22	1.39	1.57	1.78	2.01
38CKM024-X(-7,QQ)									
30 (-1.1)	TCG	19.90	18.90	17.90	16.90	15.80	14.70	13.40	12.00
	SDT	67.60	76.90	86.40	95.80	105.20	114.60	124.00	133.20
	KW	1.01	1.14	1.28	1.43	1.60	1.80	2.02	2.27
35 (1.7)	TCG	22.10	21.00	19.90	18.80	17.60	16.40	15.00	13.60
	SDT	68.90	78.10	87.50	96.90	106.30	115.60	124.90	134.10
	KW	1.02	1.15	1.28	1.44	1.61	1.81	2.03	2.28
40 (4.4)	TCG	24.50	23.20	22.00	20.80	19.50	18.20	16.80	15.20
	SDT	70.20	79.40	88.70	98.00	107.30	116.60	125.90	135.10
	KW	1.03	1.15	1.29	1.44	1.62	1.81	2.04	2.30
45 (7.2)	TCG	27.00	25.60	24.20	22.90	21.50	20.10	18.60	16.90
	SDT	71.70	80.80	90.00	99.20	108.40	117.70	126.90	136.00
	KW	1.03	1.16	1.29	1.45	1.62	1.82	2.05	2.30
50 (10)	TCG	29.60	28.10	26.60	25.20	23.70	22.10	20.40	18.70
	SDT	73.20	82.20	91.30	100.50	109.60	118.80	127.90	137.00
	KW	1.03	1.16	1.29	1.45	1.63	1.82	2.05	2.31
55 (12.8)	TCG	32.50	30.80	29.10	27.50	25.90	24.20	22.40	20.50
	SDT	74.80	83.70	92.70	101.80	110.90	119.90	129.00	138.00
	KW	1.03	1.15	1.29	1.45	1.63	1.83	2.06	2.32
38CKM030-X(-7,QQ)									
30 (-1.1)	TCG	27.20	25.80	24.40	23.00	21.40	19.70	18.00	16.10
	SDT	68.30	77.90	87.40	96.90	106.30	115.70	125.10	134.60
	KW	1.23	1.43	1.63	1.85	2.10	2.39	2.74	3.14
35 (1.7)	TCG	30.10	28.60	27.10	25.50	23.90	22.10	20.20	18.30
	SDT	69.50	79.00	88.50	97.90	107.30	116.70	126.00	135.30
	KW	1.24	1.44	1.64	1.86	2.11	2.40	2.74	3.13
40 (4.4)	TCG	33.20	31.60	30.00	28.30	26.50	24.60	22.60	20.50
	SDT	70.70	80.20	89.60	99.00	108.40	117.70	126.90	136.20
	KW	1.24	1.45	1.66	1.88	2.13	2.41	2.74	3.13
45 (7.2)	TCG	36.50	34.80	33.00	31.20	29.30	27.30	25.10	22.90
	SDT	72.10	81.50	90.90	100.20	109.50	118.80	128.00	137.10
	KW	1.25	1.46	1.67	1.90	2.15	2.43	2.76	3.14
50 (10)	TCG	40.00	38.10	36.20	34.30	32.20	30.10	27.80	25.40
	SDT	73.50	82.90	92.20	101.50	110.80	120.00	129.10	138.20
	KW	1.27	1.48	1.69	1.92	2.17	2.45	2.78	3.15
55 (12.8)	TCG	43.70	41.70	39.60	37.50	35.30	33.00	30.60	28.10
	SDT	75.00	84.30	93.60	102.90	112.10	121.20	130.30	139.30
	KW	1.28	1.50	1.72	1.95	2.20	2.48	2.81	3.18

See notes on page 23

CONDENSER ONLY RATINGS - ENGLISH

SST °F (°C)		CONDENSER ENTERING AIR TEMPERATURES °F (°C)							
		55 (12.8)	65 (18.3)	75 (23.9)	85 (29.4)	95 (35)	105 (40.6)	115 (46.1)	125 (51.7)
38CKM036-X(-7,QQ)									
30 (-1.1)	TCG	31.70	30.10	28.40	26.60	23.90	22.00	20.00	18.00
	SDT	69.60	79.00	88.30	97.70	107.00	116.40	125.80	135.20
	KW	1.46	1.69	1.92	2.18	2.47	2.81	3.19	3.62
35 (1.7)	TCG	35.40	33.60	31.70	29.70	26.90	24.70	22.60	20.40
	SDT	71.00	80.40	89.70	99.00	108.20	117.50	126.80	136.10
	KW	1.47	1.70	1.94	2.20	2.49	2.82	3.20	3.64
40 (4.4)	TCG	39.30	37.30	35.20	33.00	30.00	27.70	25.30	22.90
	SDT	72.60	81.90	91.10	100.30	109.40	118.60	127.90	137.10
	KW	1.49	1.71	1.95	2.21	2.50	2.83	3.21	3.65
45 (7.2)	TCG	43.40	41.20	38.90	36.50	33.30	30.80	28.20	25.60
	SDT	74.30	83.50	92.60	101.80	110.80	119.90	129.00	138.20
	KW	1.51	1.73	1.97	2.23	2.52	2.85	3.23	3.67
50 (10)	TCG	47.70	45.30	42.90	40.20	36.80	34.00	31.20	28.40
	SDT	76.10	85.10	94.20	103.30	112.20	121.20	130.30	139.30
	KW	1.53	1.75	1.99	2.25	2.54	2.87	3.25	3.69
55 (12.8)	TCG	52.20	49.60	46.90	44.10	40.40	37.50	34.40	31.30
	SDT	77.90	86.90	95.90	104.90	113.70	122.70	131.60	140.60
	KW	1.56	1.78	2.01	2.27	2.56	2.90	3.28	3.71
38CKM036-X(-9,QR)									
30 (-1.1)	TCG	33.00	31.50	29.90	28.10	25.60	23.70	21.80	19.90
	SDT	69.50	79.00	88.40	97.80	107.20	116.60	126.10	135.60
	KW	1.50	1.72	1.95	2.21	2.50	2.82	3.20	3.63
35 (1.7)	TCG	36.50	34.80	33.00	31.10	28.40	26.30	24.30	22.20
	SDT	70.90	80.20	89.60	99.00	108.20	117.60	127.00	136.40
	KW	1.51	1.73	1.96	2.22	2.50	2.83	3.21	3.64
40 (4.4)	TCG	40.20	38.30	36.30	34.20	31.30	29.10	26.90	24.60
	SDT	72.30	81.60	90.90	100.20	109.40	118.70	128.00	137.30
	KW	1.52	1.74	1.97	2.23	2.52	2.84	3.22	3.65
45 (7.2)	TCG	44.10	42.10	39.80	37.50	34.40	32.00	29.60	27.20
	SDT	73.80	83.00	92.20	101.50	110.60	119.80	129.10	138.30
	KW	1.54	1.75	1.99	2.24	2.53	2.85	3.23	3.66
50 (10)	TCG	48.30	46.00	43.60	41.00	37.70	35.10	32.50	29.80
	SDT	75.40	84.60	93.70	102.80	111.80	121.00	130.20	139.30
	KW	1.56	1.77	2.00	2.26	2.54	2.87	3.24	3.68
55 (12.8)	TCG	52.70	50.10	47.40	44.70	41.20	38.30	35.50	32.60
	SDT	77.20	86.20	95.20	104.30	113.20	122.30	131.40	140.50
	KW	1.58	1.79	2.02	2.28	2.56	2.89	3.26	3.69
38CKM042-X(-9,QR)									
30 (-1.1)	TCG	38.10	36.40	34.60	32.20	30.20	28.20	26.00	23.70
	SDT	68.90	78.40	87.80	97.10	106.50	115.90	125.20	134.50
	KW	1.70	1.95	2.21	2.49	2.80	3.14	3.53	3.98
35 (1.7)	TCG	42.20	40.20	38.20	35.50	33.30	31.10	28.80	26.30
	SDT	70.30	79.70	89.00	98.20	107.60	116.90	126.20	135.40
	KW	1.70	1.96	2.23	2.51	2.82	3.16	3.56	4.00
40 (4.4)	TCG	46.60	44.30	42.00	39.00	36.70	34.20	31.70	29.10
	SDT	71.80	81.10	90.30	99.40	108.70	118.00	127.10	136.30
	KW	1.71	1.97	2.24	2.52	2.84	3.19	3.58	4.02
45 (7.2)	TCG	51.30	48.60	46.00	42.80	40.20	37.60	34.80	32.10
	SDT	73.40	82.60	91.70	100.70	109.90	119.10	128.20	137.30
	KW	1.70	1.97	2.25	2.53	2.86	3.21	3.60	4.05
50 (10)	TCG	56.20	53.20	50.30	46.80	44.00	41.10	38.20	35.20
	SDT	75.20	84.20	93.20	102.10	111.20	120.30	129.30	138.30
	KW	1.70	1.97	2.26	2.55	2.87	3.23	3.63	4.07
55 (12.8)	TCG	61.50	58.10	54.90	51.10	48.00	44.80	41.70	38.40
	SDT	77.10	85.90	94.80	103.60	112.60	121.50	130.50	139.40
	KW	1.69	1.97	2.26	2.56	2.89	3.25	3.66	4.10

See notes on page 23

CONDENSER ONLY RATINGS - ENGLISH

SST °F (°C)		CONDENSER ENTERING AIR TEMPERATURES °F (°C)							
SST °F (°C)		55 (12.8)	65 (18.3)	75 (23.9)	85 (29.4)	95 (35)	105 (40.6)	115 (46.1)	125 (51.7)
38CKM048-X(-9,QR)									
30 (-1.1)	TCG	43.10	41.10	39.00	36.90	34.60	32.30	29.90	27.50
	SDT	71.30	80.70	90.00	99.30	108.60	117.90	127.10	136.30
	KW	2.06	2.31	2.59	2.89	3.24	3.62	4.06	4.55
35 (1.7)	TCG	47.30	45.10	42.80	40.50	38.10	35.60	33.00	30.30
	SDT	72.90	82.10	91.40	100.60	109.90	119.00	128.20	137.30
	KW	2.09	2.34	2.61	2.92	3.27	3.65	4.09	4.58
40 (4.4)	TCG	51.80	49.40	46.90	44.30	41.70	39.00	36.20	33.30
	SDT	74.50	83.70	92.90	102.10	111.20	120.30	129.30	138.30
	KW	2.11	2.36	2.64	2.95	3.30	3.69	4.13	4.62
45 (7.2)	TCG	56.60	54.00	51.20	48.40	45.60	42.60	39.60	36.40
	SDT	76.30	85.40	94.50	103.60	112.60	121.60	130.60	139.50
	KW	2.14	2.39	2.67	2.98	3.33	3.72	4.16	4.66
50 (10)	TCG	61.80	58.80	55.80	52.80	49.70	46.40	43.10	39.70
	SDT	78.20	87.20	96.20	105.10	114.10	123.00	131.90	140.60
	KW	2.17	2.42	2.70	3.01	3.37	3.76	4.21	4.70
55 (12.8)	TCG	67.20	64.00	60.70	57.40	54.00	50.50	46.90	43.20
	SDT	80.30	89.10	98.00	106.90	115.70	124.50	133.20	141.90
	KW	2.20	2.45	2.73	3.05	3.41	3.80	4.25	4.75
38CKM060-X(-9,QR)									
30 (-1.1)	TCG	55.40	52.70	49.90	46.40	43.40	40.30	36.70	33.30
	SDT	73.70	83.00	92.20	101.30	110.50	119.60	128.60	137.60
	KW	2.39	2.73	3.11	3.51	3.98	4.52	5.15	5.87
35 (1.7)	TCG	60.90	57.80	54.80	51.00	47.80	44.40	40.60	37.00
	SDT	75.50	84.70	93.90	102.80	111.90	120.90	129.90	138.80
	KW	2.44	2.79	3.16	3.57	4.04	4.58	5.20	5.92
40 (4.4)	TCG	66.60	63.30	59.90	55.90	52.40	48.80	44.70	40.80
	SDT	77.40	86.50	95.60	104.40	113.40	122.30	131.20	140.00
	KW	2.49	2.85	3.23	3.63	4.11	4.65	5.27	5.98
45 (7.2)	TCG	72.80	69.10	65.40	61.10	57.30	53.40	49.00	44.80
	SDT	79.50	88.50	97.40	106.10	115.00	123.90	132.60	141.30
	KW	2.56	2.92	3.30	3.71	4.18	4.72	5.34	6.04
50 (10)	TCG	79.20	75.20	71.20	66.60	62.40	58.20	53.60	49.00
	SDT	81.70	90.50	99.40	107.90	116.70	125.40	134.00	142.60
	KW	2.64	3.00	3.38	3.79	4.27	4.81	5.42	6.12
55 (12.8)	TCG	86.00	81.60	77.30	72.30	67.80	63.30	58.30	53.50
	SDT	84.00	92.70	101.50	109.80	118.50	127.10	135.60	144.10
	KW	2.73	3.09	3.48	3.88	4.36	4.90	5.51	6.21

KW – Total Power (kW)

SDT – Saturated Temperature Leaving Compressor (°F)

SST – Saturated Temperature Entering Compressor (°F)

TCG – Gross Cooling Capacity (1000 Btuh)

CONDENSER ONLY RATINGS - S.I.

SST °C		CONDENSER ENTERING AIR TEMPERATURES °C							
		13	18	24	29	35	41	46	52
38CKM018-X(-7,QQ)									
-1	TCG	5.10	4.90	4.70	4.30	4.00	3.70	3.40	3.10
	SDT	18.00	24.00	29.00	35.00	40.00	45.00	51.00	56.00
	KW	0.79	0.92	1.06	1.20	1.36	1.53	1.74	1.99
2	TCG	5.70	5.50	5.20	4.80	4.50	4.20	3.80	3.50
	SDT	19.00	24.00	30.00	35.00	40.00	46.00	51.00	56.00
	KW	0.78	0.92	1.05	1.20	1.36	1.54	1.74	1.99
4	TCG	6.30	6.00	5.70	5.30	5.00	4.60	4.30	3.90
	SDT	20.00	25.00	30.00	36.00	41.00	46.00	51.00	57.00
	KW	0.76	0.91	1.05	1.20	1.36	1.54	1.75	1.99
7	TCG	7.00	6.70	6.30	5.80	5.50	5.10	4.70	4.30
	SDT	20.00	26.00	31.00	36.00	41.00	47.00	52.00	57.00
	KW	0.75	0.90	1.05	1.20	1.37	1.55	1.76	1.99
10	TCG	7.70	7.30	6.90	6.40	6.00	5.60	5.20	4.80
	SDT	21.00	26.00	31.00	37.00	42.00	47.00	52.00	58.00
	KW	0.74	0.90	1.05	1.21	1.38	1.56	1.76	2.00
13	TCG	8.40	8.00	7.60	7.00	6.50	6.10	5.70	5.20
	SDT	22.00	27.00	32.00	37.00	43.00	48.00	53.00	58.00
	KW	0.74	0.90	1.06	1.22	1.39	1.57	1.78	2.01
38CKM024-X(-7,QQ)									
-1	TCG	5.80	5.50	5.20	4.90	4.60	4.30	3.90	3.50
	SDT	20.00	25.00	30.00	35.00	41.00	46.00	51.00	56.00
	KW	1.01	1.14	1.28	1.43	1.60	1.80	2.02	2.27
2	TCG	6.50	6.10	5.80	5.50	5.20	4.80	4.40	4.00
	SDT	20.00	26.00	31.00	36.00	41.00	46.00	52.00	57.00
	KW	1.02	1.15	1.28	1.44	1.61	1.81	2.03	2.28
4	TCG	7.20	6.80	6.40	6.10	5.70	5.30	4.90	4.50
	SDT	21.00	26.00	31.00	37.00	42.00	47.00	52.00	57.00
	KW	1.03	1.15	1.29	1.44	1.62	1.81	2.04	2.30
7	TCG	7.90	7.50	7.10	6.70	6.30	5.90	5.40	5.00
	SDT	22.00	27.00	32.00	37.00	42.00	48.00	53.00	58.00
	KW	1.03	1.16	1.29	1.45	1.62	1.82	2.05	2.30
10	TCG	8.70	8.20	7.80	7.40	6.90	6.50	6.00	5.50
	SDT	23.00	28.00	33.00	38.00	43.00	48.00	53.00	58.00
	KW	1.03	1.16	1.29	1.45	1.63	1.82	2.05	2.31
13	TCG	9.50	9.00	8.50	8.10	7.60	7.10	6.60	6.00
	SDT	24.00	29.00	34.00	39.00	44.00	49.00	54.00	59.00
	KW	1.03	1.15	1.29	1.45	1.63	1.83	2.06	2.32
38CKM030-X(-7,QQ)									
-1	TCG	8.00	7.60	7.20	6.70	6.30	5.80	5.30	4.70
	SDT	20.00	25.00	31.00	36.00	41.00	47.00	52.00	57.00
	KW	1.23	1.43	1.63	1.85	2.10	2.39	2.74	3.14
2	TCG	8.80	8.40	7.90	7.50	7.00	6.50	5.90	5.30
	SDT	21.00	26.00	31.00	37.00	42.00	47.00	52.00	57.00
	KW	1.24	1.44	1.64	1.86	2.11	2.40	2.74	3.13
4	TCG	9.70	9.30	8.80	8.30	7.80	7.20	6.60	6.00
	SDT	22.00	27.00	32.00	37.00	42.00	48.00	53.00	58.00
	KW	1.24	1.45	1.66	1.88	2.13	2.41	2.74	3.13
7	TCG	10.70	10.20	9.70	9.10	8.60	8.00	7.40	6.70
	SDT	22.00	27.00	33.00	38.00	43.00	48.00	53.00	58.00
	KW	1.25	1.46	1.67	1.90	2.15	2.43	2.76	3.14
10	TCG	11.70	11.20	10.60	10.00	9.40	8.80	8.10	7.50
	SDT	23.00	28.00	33.00	39.00	44.00	49.00	54.00	59.00
	KW	1.27	1.48	1.69	1.92	2.17	2.45	2.78	3.15
13	TCG	12.80	12.20	11.60	11.00	10.30	9.70	9.00	8.20
	SDT	24.00	29.00	34.00	39.00	44.00	50.00	55.00	60.00
	KW	1.28	1.50	1.72	1.95	2.20	2.48	2.81	3.18

See notes on page 26

CONDENSER ONLY RATINGS - S.I.

SST °C		CONDENSER ENTERING AIR TEMPERATURES °C							
		13	18	24	29	35	41	46	52
38CKM036-X(-7,QQ)									
-1	TCG	9.30	8.80	8.30	7.80	7.00	6.40	5.90	5.30
	SDT	21.00	26.00	31.00	37.00	42.00	47.00	52.00	57.00
	KW	1.46	1.69	1.92	2.18	2.47	2.81	3.19	3.62
2	TCG	10.40	9.90	9.30	8.70	7.90	7.20	6.60	6.00
	SDT	22.00	27.00	32.00	37.00	42.00	47.00	53.00	58.00
	KW	1.47	1.70	1.94	2.20	2.49	2.82	3.20	3.64
4	TCG	11.50	10.90	10.30	9.70	8.80	8.10	7.40	6.70
	SDT	23.00	28.00	33.00	38.00	43.00	48.00	53.00	58.00
	KW	1.49	1.71	1.95	2.21	2.50	2.83	3.21	3.65
7	TCG	12.70	12.10	11.40	10.70	9.80	9.00	8.30	7.50
	SDT	23.00	29.00	34.00	39.00	44.00	49.00	54.00	59.00
	KW	1.51	1.73	1.97	2.23	2.52	2.85	3.23	3.67
10	TCG	14.00	13.30	12.60	11.80	10.80	10.00	9.20	8.30
	SDT	24.00	30.00	35.00	40.00	45.00	50.00	55.00	60.00
	KW	1.53	1.75	1.99	2.25	2.54	2.87	3.25	3.69
13	TCG	15.30	14.50	13.80	12.90	11.80	11.00	10.10	9.20
	SDT	26.00	31.00	35.00	41.00	45.00	50.00	55.00	60.00
	KW	1.56	1.78	2.01	2.27	2.56	2.90	3.28	3.71
38CKM036-X(-9,QR)									
-1	TCG	9.70	9.20	8.80	8.20	7.50	7.00	6.40	5.80
	SDT	21.00	26.00	31.00	37.00	42.00	47.00	52.00	58.00
	KW	1.50	1.72	1.95	2.21	2.50	2.82	3.20	3.63
2	TCG	10.70	10.20	9.70	9.10	8.30	7.70	7.10	6.50
	SDT	22.00	27.00	32.00	37.00	42.00	48.00	53.00	58.00
	KW	1.51	1.73	1.96	2.22	2.50	2.83	3.21	3.64
4	TCG	11.80	11.20	10.60	10.00	9.20	8.50	7.90	7.20
	SDT	22.00	28.00	33.00	38.00	43.00	48.00	53.00	59.00
	KW	1.52	1.74	1.97	2.23	2.52	2.84	3.22	3.65
7	TCG	12.90	12.30	11.70	11.00	10.10	9.40	8.70	8.00
	SDT	23.00	28.00	33.00	39.00	44.00	49.00	54.00	59.00
	KW	1.54	1.75	1.99	2.24	2.53	2.85	3.23	3.66
10	TCG	14.20	13.50	12.80	12.00	11.10	10.30	9.50	8.70
	SDT	24.00	29.00	34.00	39.00	44.00	49.00	55.00	60.00
	KW	1.56	1.77	2.00	2.26	2.54	2.87	3.24	3.68
13	TCG	15.40	14.70	13.90	13.10	12.10	11.20	10.40	9.60
	SDT	25.00	30.00	35.00	40.00	45.00	50.00	55.00	60.00
	KW	1.58	1.79	2.02	2.28	2.56	2.89	3.26	3.69
38CKM042-X(-9,QR)									
-1	TCG	11.20	10.70	10.10	9.40	8.90	8.20	7.60	6.90
	SDT	20.00	26.00	31.00	36.00	41.00	47.00	52.00	57.00
	KW	1.70	1.95	2.21	2.49	2.80	3.14	3.53	3.98
2	TCG	12.40	11.80	11.20	10.40	9.80	9.10	8.40	7.70
	SDT	21.00	26.00	32.00	37.00	42.00	47.00	52.00	57.00
	KW	1.70	1.96	2.23	2.51	2.82	3.16	3.56	4.00
4	TCG	13.70	13.00	12.30	11.40	10.70	10.00	9.30	8.50
	SDT	22.00	27.00	32.00	37.00	43.00	48.00	53.00	58.00
	KW	1.71	1.97	2.24	2.52	2.84	3.19	3.58	4.02
7	TCG	15.00	14.20	13.50	12.50	11.80	11.00	10.20	9.40
	SDT	23.00	28.00	33.00	38.00	43.00	48.00	53.00	58.00
	KW	1.70	1.97	2.25	2.53	2.86	3.21	3.60	4.05
10	TCG	16.50	15.60	14.70	13.70	12.90	12.00	11.20	10.30
	SDT	24.00	29.00	34.00	39.00	44.00	49.00	54.00	59.00
	KW	1.70	1.97	2.26	2.55	2.87	3.23	3.63	4.07
13	TCG	18.00	17.00	16.10	15.00	14.10	13.10	12.20	11.30
	SDT	25.00	30.00	35.00	40.00	45.00	50.00	55.00	60.00
	KW	1.69	1.97	2.26	2.56	2.89	3.25	3.66	4.10

See notes on page 26

CONDENSER ONLY RATINGS - S.I.

SST °C		CONDENSER ENTERING AIR TEMPERATURES °C							
		13	18	24	29	35	41	46	52
38CKM048-X(-9,QR)									
-1	TCG	12.60	12.00	11.40	10.80	10.10	9.50	8.80	8.00
	SDT	22.00	27.00	32.00	37.00	43.00	48.00	53.00	58.00
	KW	2.06	2.31	2.59	2.89	3.24	3.62	4.06	4.55
2	TCG	13.90	13.20	12.50	11.90	11.20	10.40	9.70	8.90
	SDT	23.00	28.00	33.00	38.00	43.00	48.00	53.00	58.00
	KW	2.09	2.34	2.61	2.92	3.27	3.65	4.09	4.58
4	TCG	15.20	14.50	13.70	13.00	12.20	11.40	10.60	9.80
	SDT	24.00	29.00	34.00	39.00	44.00	49.00	54.00	59.00
	KW	2.11	2.36	2.64	2.95	3.30	3.69	4.13	4.62
7	TCG	16.60	15.80	15.00	14.20	13.40	12.50	11.60	10.70
	SDT	25.00	30.00	35.00	40.00	45.00	50.00	55.00	60.00
	KW	2.14	2.39	2.67	2.98	3.33	3.72	4.16	4.66
10	TCG	18.10	17.20	16.40	15.50	14.50	13.60	12.60	11.60
	SDT	26.00	31.00	36.00	41.00	46.00	51.00	55.00	60.00
	KW	2.17	2.42	2.70	3.01	3.37	3.76	4.21	4.70
13	TCG	19.70	18.80	17.80	16.80	15.80	14.80	13.70	12.70
	SDT	27.00	32.00	37.00	42.00	46.00	51.00	56.00	61.00
	KW	2.20	2.45	2.73	3.05	3.41	3.80	4.25	4.75
38CKM060-X(-9,QR)									
-1	TCG	16.20	15.40	14.60	13.60	12.70	11.80	10.80	9.80
	SDT	23.00	28.00	33.00	38.00	44.00	49.00	54.00	59.00
	KW	2.39	2.73	3.11	3.51	3.98	4.52	5.15	5.87
2	TCG	17.80	16.90	16.00	15.00	14.00	13.00	11.90	10.80
	SDT	24.00	29.00	34.00	39.00	44.00	49.00	54.00	59.00
	KW	2.44	2.79	3.16	3.57	4.04	4.58	5.20	5.92
4	TCG	19.50	18.50	17.60	16.40	15.40	14.30	13.10	11.90
	SDT	25.00	30.00	35.00	40.00	45.00	50.00	55.00	60.00
	KW	2.49	2.85	3.23	3.63	4.11	4.65	5.27	5.98
7	TCG	21.30	20.20	19.20	17.90	16.80	15.60	14.40	13.10
	SDT	26.00	31.00	36.00	41.00	46.00	51.00	56.00	61.00
	KW	2.56	2.92	3.30	3.71	4.18	4.72	5.34	6.04
10	TCG	23.20	22.00	20.90	19.50	18.30	17.10	15.70	14.40
	SDT	28.00	33.00	37.00	42.00	47.00	52.00	57.00	61.00
	KW	2.64	3.00	3.38	3.79	4.27	4.81	5.42	6.12
13	TCG	25.20	23.90	22.60	21.20	19.90	18.50	17.10	15.70
	SDT	29.00	34.00	39.00	43.00	48.00	53.00	58.00	62.00
	KW	2.73	3.09	3.48	3.88	4.36	4.90	5.51	6.21

KW – Total Power (kW)

SDT – Saturated Temperature Leaving Compressor (°C)

SST – Saturated Temperature Entering Compressor (°C)

TCG – Gross Cooling Capacity (1000 kW)

SYSTEM DESIGN

1. Intended for outdoor installation with free air inlet and outlet. Outdoor fan external static pressure available is less than 0.01-in. wc.
2. Minimum outdoor operating air temperature without low-ambient operation accessory is 55°F (12.8°C).
3. Maximum outdoor operating air temperature is 125.6°F (52°C).
4. For reliable operation, unit should be level in all horizontal planes.
5. Maximum elevation of indoor coil above or below base of outdoor unit is: indoor coil above = 80 ft (24.38 m), indoor coil below = 200 ft (60.96 m).
6. For interconnecting refrigerant tube lengths greater than 80 ft (24.38 m) horizontal or 20 ft (6.10 m) vertical differential, consult Residential Split System Long-Line Application Guideline available from equipment distributor.
7. Crankcase heater required when interconnecting refrigerant tube length exceeds 80 ft (24.38 m).
8. If any refrigerant tubing is buried, provide a minimum 6 in (152.4 mm) vertical rise to the valve connections at the unit. Refrigerant tubing lengths up to 36 in (914.4 mm) may be buried without further consideration.
9. Use only copper wire for electric connection at unit. Aluminum and clad aluminum are not acceptable for the type of connector provided.

GUIDE SPECIFICATIONS

GENERAL

AIR-COOLED, SPLIT-SYSTEM AIR CONDITIONER 38CKM 1-1/2 TO 5 NOMINAL TONS

System Description

Outdoor-mounted, air-cooled, split-system air conditioner unit suitable for ground or rooftop installation. Unit consists of a hermetic compressor, an air-cooled coil, propeller-type condenser fan, and a control box. Unit will discharge supply air upward as shown on contract drawings. Unit will be used in a refrigeration circuit to match up to a packaged fan coil or coil unit.

Quality Assurance

- Units tested and rated as per: ISO 13253:2011 and UAE.S 5010-5/2019
- Unit construction will comply with latest edition of ANSI/ASHRAE and with NEC.
- Unit will be constructed in accordance with UL standards.
- Unit cabinet will be capable of withstanding Federal Test Method Standard No. 141 (Method 6061) 500-hr salt spray test.
- Air-cooled condenser coils will be leak tested at 250 psig on the low side and pressure tested at 450 psig on the high side.
- Unit constructed in ISO 9001 approved facility.

Delivery, Storage, and Handling

- Unit will be shipped as single package only and is stored and handled per unit manufacturer's recommendations.

PRODUCTS

Equipment

- Factory-assembled, single-piece, air-cooled air conditioner unit. Contained within the unit enclosure is all factory wiring, piping, controls, compressor, refrigerant charge (R-410a), and special features required prior to field start-up.

Unit Cabinet

- Unit cabinet will be constructed of galvanized, prepainted steel.

Fans

- Condenser fan will be direct-drive propeller type, discharging air upward.
- Condenser fan motors will be totally enclosed, 1-phase type with class B insulation and permanently lubricated bearings. Shafts will be corrosion resistant.
- Fan blades will be statically and dynamically balanced.
- Condenser fan openings will be equipped with coated steel wire safety guards.

Compressor

- Compressor will be hermetically sealed.
- Compressor will be mounted on rubber vibration isolators.

Condenser Coil

- Condenser coil will be air cooled.
- Coil will be constructed of modified polymer coated, aluminum fins mechanically bonded to copper tubes which are then cleaned, dehydrated, and sealed.
- Coil will be capable of withstanding 1000-hr salt spray test (per ASMB117 test method).

Refrigeration Components

- Refrigeration circuit components will include liquid line shutoff valve with sweat connections, suction line shutoff valves with sweat connections, system charge of R-410a refrigerant, and compressor oil.

Operating Characteristics

- Units suitable for 125.6°F / 52°C ambient.
- The capacity of the unit will meet or exceed _____ Btuh at a suction temperature of _____ °F (°C). The power consumption at full load will not exceed _____ kW.
- Combination of the unit and the evaporator or fan coil unit will have a total net cooling capacity of _____ Btuh or greater at conditions of _____ CFM entering air temperature at the evaporator at _____ °F (°C) wet bulb and _____ °F (°C) dry bulb, and air entering the unit at _____ °F (°C).

Electrical Requirements

- Nominal unit electrical characteristics will be _____ v, single phase, 50 hz. The unit will be capable of satisfactory operation within voltage limits of _____ v to _____ v.
- Nominal unit electrical characteristics will be _____ v, three phase, 50 hz. The unit will be capable of satisfactory operation within voltage limits of _____ v to _____ v.
- Unit electrical power will be single point connection.
- Control circuit will be 24v.
- In 3-phase units, a circuit board will be factory installed to monitor line voltage.

Special Features

- Refer to section of this literature identifying accessories and descriptions for specific features and available enhancements.

42TKS (50 Hz)

Direct Expansion Fan Coil
R- 410A Refrigerant
Sizes 018 thru 060



Product Data

FAN COIL TECHNOLOGY AT ITS FINEST

The 50Hz 42TKS fan coil has the proven technology of Carrier fan coil units with Puron® refrigerant for horizontal applications. The design features contoured condensate pans with rugged drain connections, ensuring that little water is left in the unit at the end of the cooling duty cycle. The lack of standing condensate and corrosion free pans improves IAQ and product life, features homeowners appreciate.

Standard features include grooved tubing and louvered fins. Coil circuiting has also been updated to make the most of all Carrier air conditioners. Units come with solid state fan controls, 6mm thick insulation, multi- speed motors, and fully-wettable coils.



TABLE OF CONTENTS

	<u>Page</u>
FEATURES / BENEFITS.....	2
MODEL NUMBER NOMENCLATURE	3
TECHNICAL DATA.....	4
UNIT DIMENSIONS	5
ELECTRICAL DATA	6
COMBINATION MATRIX	6
WIRING DIAGRAM	7
FAN PERFORMANCE.....	8
OPTIONS AND ACCESSORIES	9
GUIDE SPECIFICATIONS	9
SAFETY CONSIDERATIONS.....	11
RECEIVING / INSTALLATION / STARTUP / SERVICE	12-16
CONTROLLER FOR DUCTED FAN COIL UNITS	17-19
TROUBLESHOOTING	20
START-UP CHECK LIST	21-22

FEATURES / BENEFITS


- Every compact one-piece unit arrives fully assembled, tested, and ready to run.
- Designed especially for high ambient environment.
- The drain pan is polyester powder coated for extra protection.
- Flexibility to provide left hand and right-hand coil connections.
- Metallic Blower double inlet forward curved blades.
- 3 speed motor.
- Standard galvanized sheet metal casing.
- Low unit height suitable for low false ceiling application.
- Washable aluminum filter.
- 6mm thickness internal insulation with 50 kg/m³ density.
- Low noise level suitable for all application.
- Sweat connections for easy installation and maintenance.

Carrier's 42TKS direct expansion fan coils are designed to cover low to medium range of air flow requirements. They are compact and ready to fit in the under-ceiling application. All units come with solid-state fan controls, 6mm insulation, quiet multi-speed motors, and fully wet coils. 42TKS are designed for ease of service in under ceiling applications. A carton template for easy location of mounting hardware simplifies installation. Coils are made of aluminum fins mechanically bonded to copper tubes for superior heat transfer. Metallic blower double inlet forward curved blades attached to 3-speed high efficiency motors. Galvanized sheet metal casing protects against rust and drain pan is polyester powder coated for extra protection. The control board with the integrated thermostat control and washable Aluminum filters are standard feature. Piping connections position (Right Hand/Left Hand) is optional, and field interchangeable for various applications.

MODEL NUMBER NOMENCLATURE

MODEL: 42 TKS – R410A Series

LOW STATIC MODELS (42TKS)

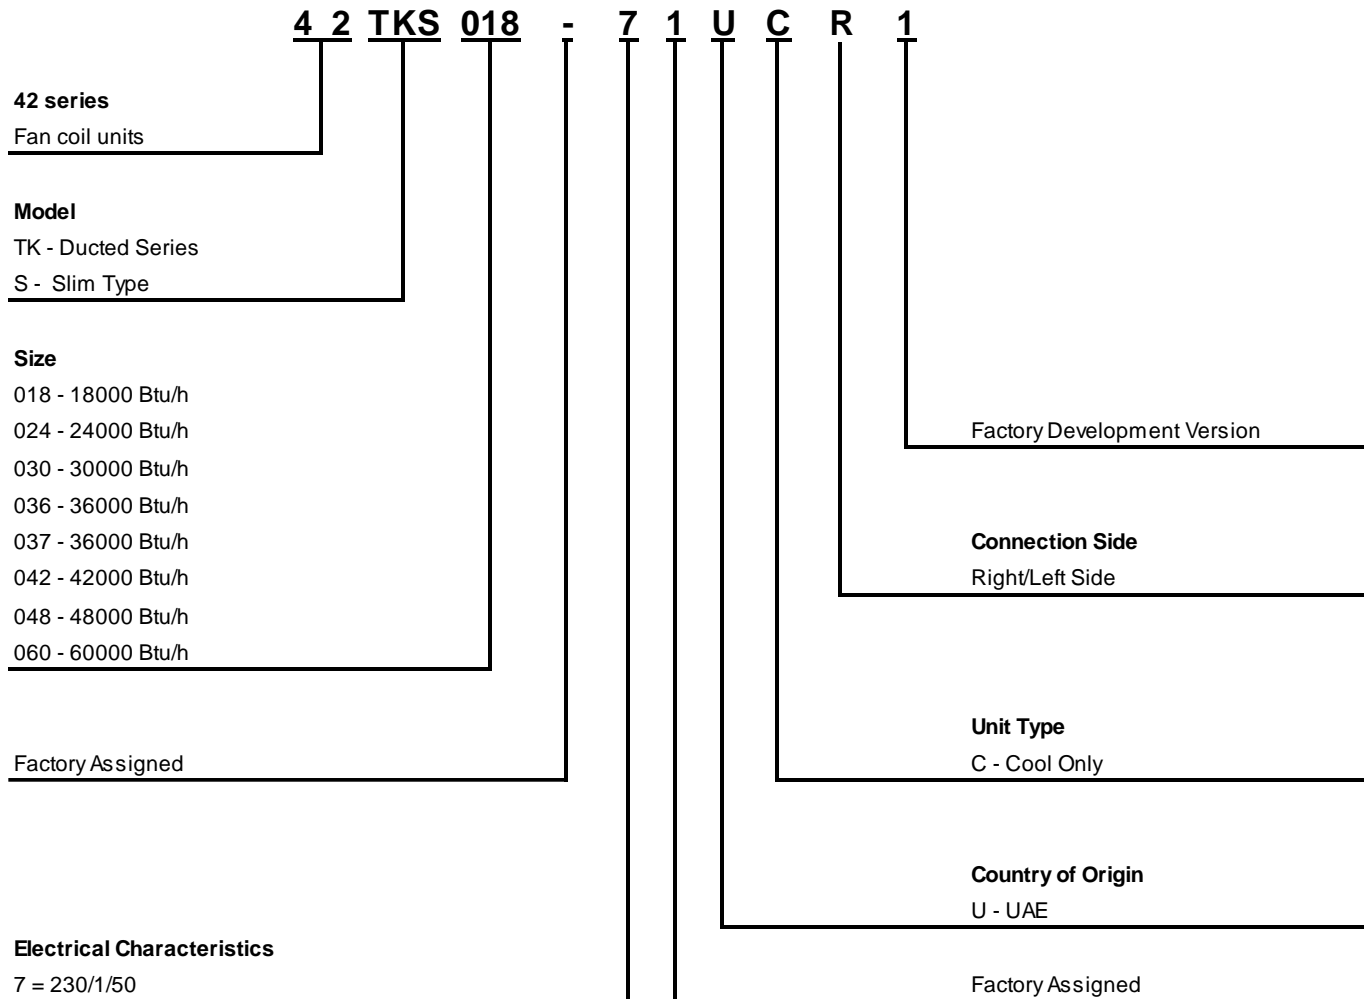


TECHNICAL DATA

42TKS Unit Size		18	24	30	36	37	42	48	60	
Unit Size	Tons	1.5	2.0	2.5	3.0	3.0	3.5	4.0	5	
Motor Rated Power	Watts	80	125		200		250	300	500	
Number of Motors / Speeds	1 / 3 Speed									
Coil Material	Tube	Inner grooved Copper Tubes								
	Fin	Aluminum Fins with Louvered profile								
Coil Face Area	m ²	0.2	0.25	0.3	0.43	0.43	0.43	0.43	0.5	
Refrigerant Metering Device	Orifice									
Piston Size		46	57	57	68	68	68	78	90	
Coil Connection Type	Soldered Connection									
Suction Connection Size	Inch	5/8		3/4			7/8			
Liquid Connection Size	Inch	3/8								
Drain Connection Size	Inch	3/4 NPT / GI Steel, Externally Threaded								
Blower	Metallic Blower with Double Inlet, Forward Curved Blades									
Filter Type	1" Washable Aluminum Filter									
Filter Quantity		1	1	2	2	2	2	2	2	
Filter Size	mm	675 x 215	900 x 215	550 x 215	550 x 315	550 x 315	550 x 315	550 x 315	650 x 315	
Sound Pressure (H/M/L) @ ESP 0.2 in.wg at 1-meter		46/43/38	50/45/39	52/45/39	53/51/48	53/51/48	54/53/50	56/54/52	57/54/53	
Unit Dimensions										
Width	mm	1040	1240	1440	1440	1440	1440	1440	1640	
Depth	mm	645								
Height	mm	275				375				
Net Weight	Kg	29	33	38	55	55	57	58	68	
Gross Weight	Kg	32	36	42	60	60	62	63	73	

UNIT DIMENSIONS

Notes:

1. The piping connections drain pan outlet and control box are located on the right-hand side facing the airflow as factory standard. Left hand connection can be provided based on request.
2. Unit shall be installed for horizontal discharge. Suspend horizontally using the factory-provided holes located at the topside flanges of the unit.

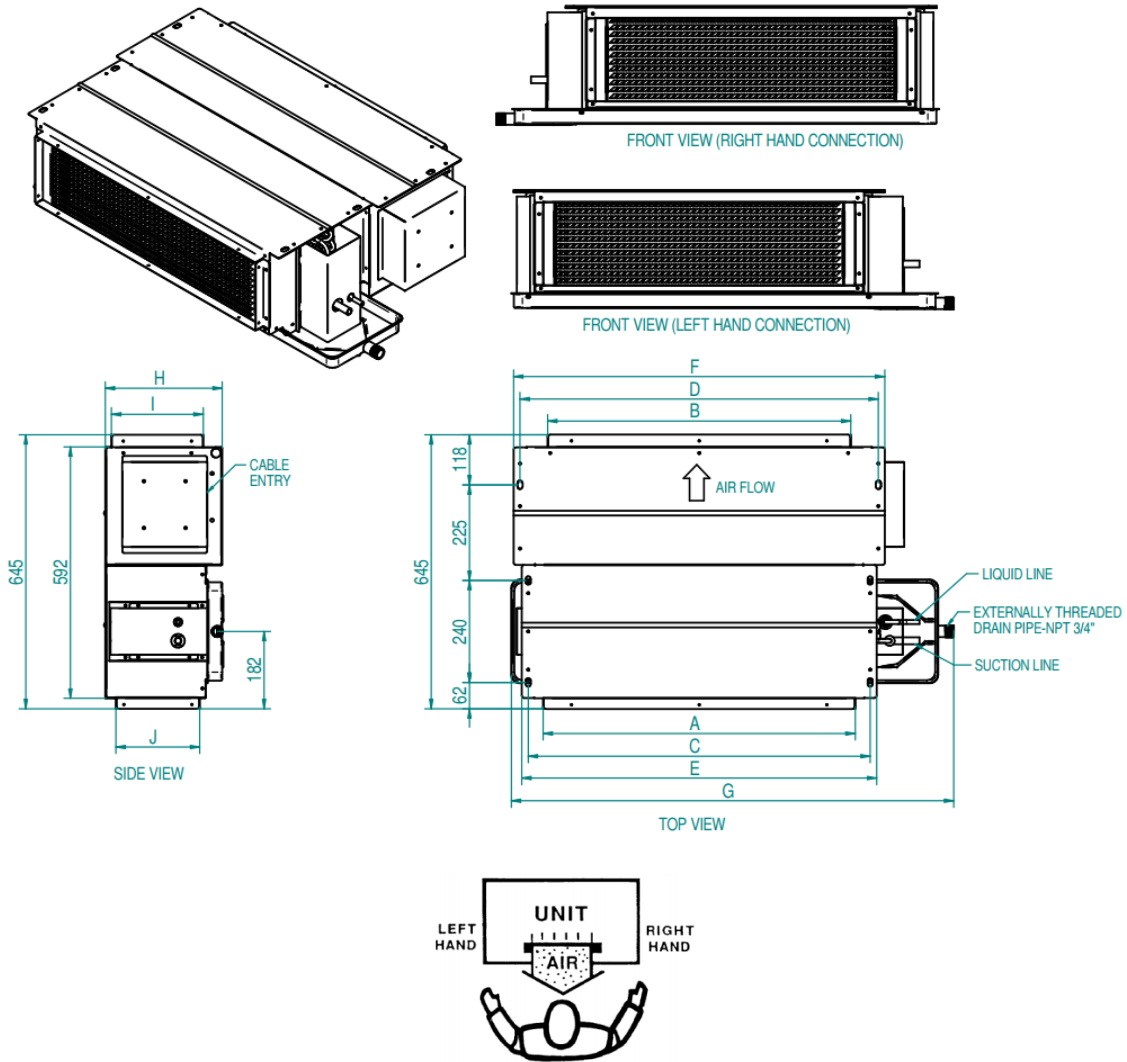

Unit Model	A	B	C	D	E	F	G	H	I	J	SUCTION LINE	LIQUID LINE
42TKS018-7	733	713	803	842	834	872	1040	275	216	197	5/8"	3/8"
42TKS024-7	958	938	1028	1067	1059	1097	1240	275	216	197	5/8"	3/8"
42TKS030-7	1158	1138	1228	1267	1259	1297	1440	275	216	197	3/4"	3/8"
42TKS036-7	1158	1138	1228	1267	1259	1297	1440	375	316	297	3/4"	3/8"
42TKS037-7	1158	1138	1228	1267	1259	1297	1440	375	316	297	3/4"	3/8"
42TKS042-7	1158	1138	1228	1267	1259	1297	1440	375	316	297	7/8"	3/8"
42TKS048-7	1158	1138	1228	1267	1259	1297	1440	375	316	297	7/8"	3/8"
42TKS060-7	1358	1338	1428	1467	1459	1497	1640	375	316	297	7/8"	3/8"

Note: Provided suction & liquid line sizes are for unit connection only; refer outdoor unit IOM for field pipe sizes.

ELECTRICAL DATA

Unit Model	Condenser Control Circuit	Power Supply	Voltage		Fan	MCA	MOCP
			Min	Max	FLA		
42TKS018-7	24V	230V/1Ph/50Hz	207	253	1.3	1.6	15
42TKS024-7					1.3	1.6	15
42TKS030-7					1.5	1.9	15
42TKS036-7					2.5	3.1	15
42TKS037-7					2.5	3.1	15
42TKS042-7					3.0	3.8	15
42TKS048-7					3.3	4.1	15
42TKS060-7					4.0	5.0	15

Legend

FLA — Full Load Amps

MCA — Minimum Circuit Amps


MOCP — Maximum Overcurrent Protection

COMBINATION MATRIX

Outdoor Model	Indoor Model	Nominal Cooling Capacity (Btuh)	Nominal Cooling Capacity (TR)	Nominal Air Flow (CFM)
Top Discharge	Fan Coil			
38CKM018-X-7	42TKS018-7	18000	1.5	600
38CKM024-X-7	42TKS024-7	24000	2.0	815
38CKM030-X-7	42TKS030-7	30000	2.5	890
38CKM036-X-7	42TKS036-7	36000	3.0	1165
38CKM036-X-9	42TKS037-7	36000	3.0	1165
38CKM042-X-9	42TKS042-7	42000	3.5	1350
38CKM048-X-9	42TKS048-7	48000	4.0	1425
38CKM060-X-9	42TKS060-7	60000	5.0	1765

For detailed performance and matchup ratings please refer to corresponding outdoor product catalog.

WIRING DIAGRAM

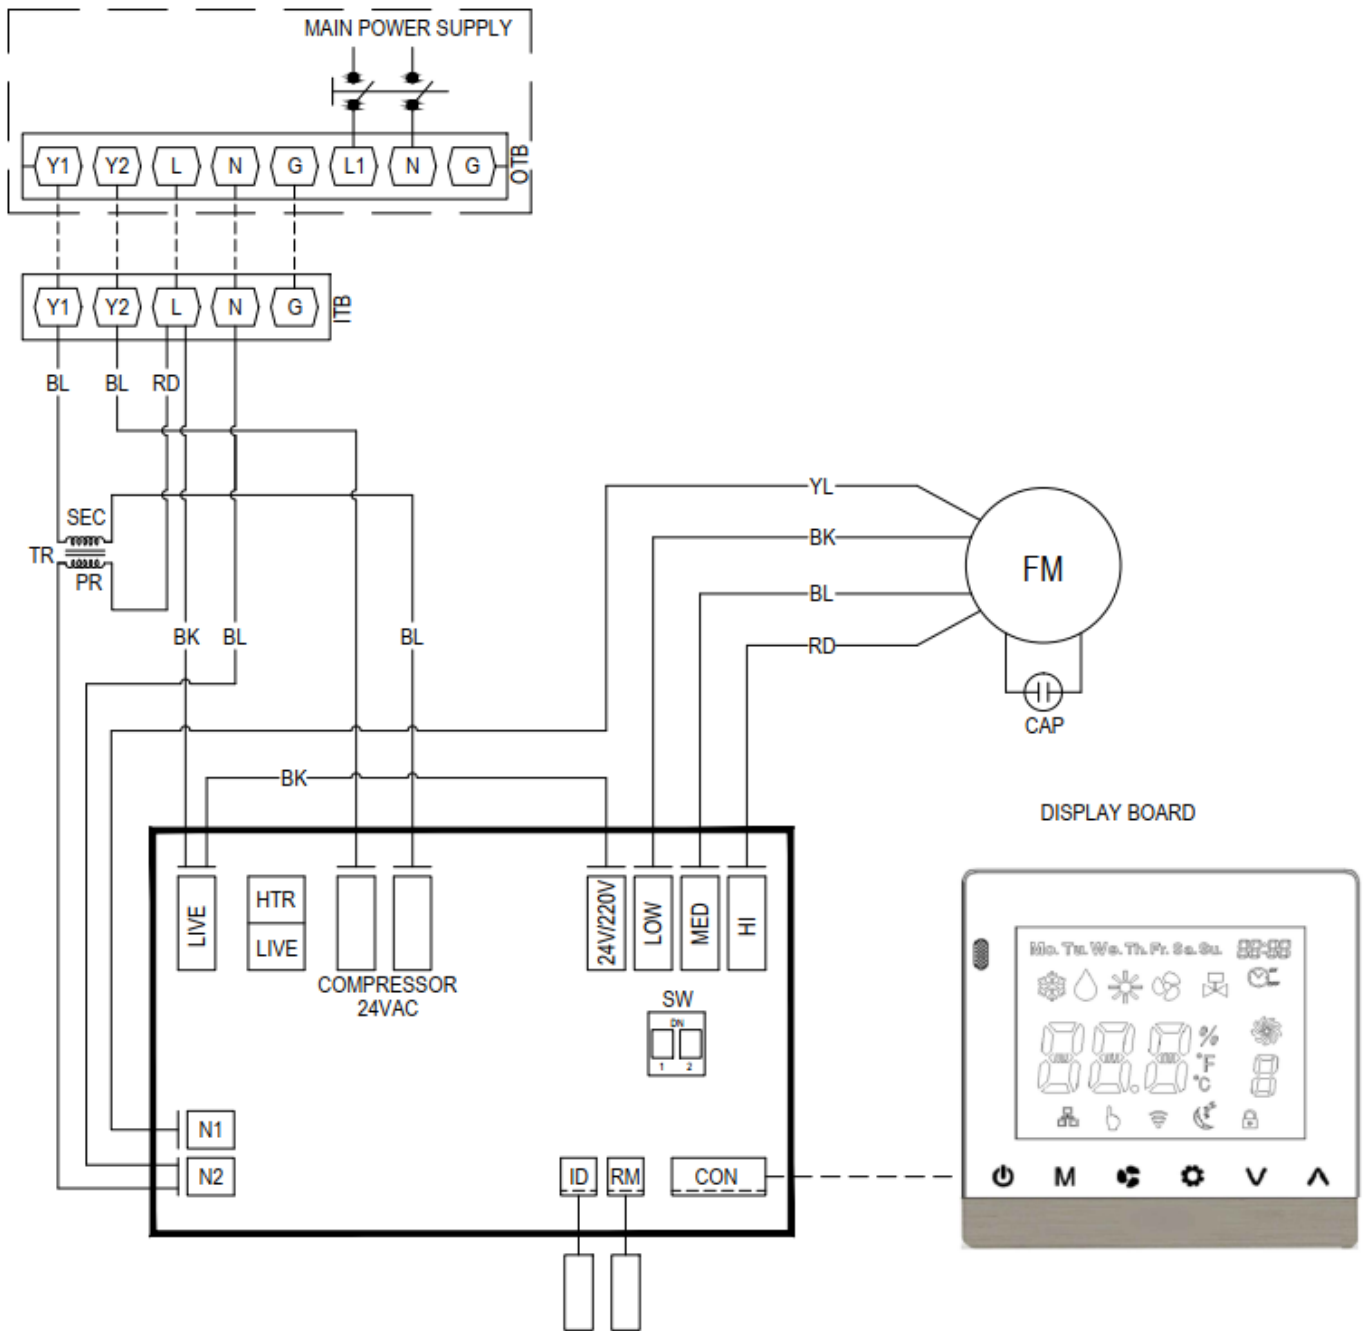

LEGEND

FM : FAN MOTOR
 CAP : CAPACITOR
 SW : DIP SWITCH
 RM : ROOM SENSOR
 ID : INDOOR COIL SENSOR
 ITB : INDOOR UNIT TERMINAL BLOCK
 OTB : OUTDOOR UNIT TERMINAL BLOCK
 TR : TRANSFORMERS
 WIRE COLORS
 BR : BROWN RD : RED
 BL : BLUE WH : WHITE
 OR : ORANGE BK : BLACK
 YL : YELLOW

TERMINAL BLOCK LEGEND

Y1 & Y2 : OUTDOOR UNIT CONTROL - 24VAC
 G : GROUND CONNECTION
 L : LIVE CONNECTION
 N : NEUTRAL CONNECTION
 NOTE
 ----- FILED WIRING

DIP SWITCH SETTING

DIP SWITCH	ON	OFF
SW1	COOL	OFF
SW2	-	DX SYSTEM

FAN PERFORMANCE

42TKS Air Flow (CFM) – English

ESP - in.wg	0.1			0.2			0.3			0.4		
Unit Model	H	M	L	H	M	L	H	M	L	H	M	L
42TKS018-7	673	600	438	621	543	392	536	473	320	438	360	242
42TKS024-7	990	815	477	936	747	432	853	679	365	761	585	261
42TKS030-7	1039	929	706	990	890	674	927	833	646	853	767	582
42TKS036-7	1316	1180	842	1296	1165	753	1262	1132	702	1200	1076	644
42TKS037-7	1316	1180	842	1296	1165	753	1262	1132	702	1200	1076	644
42TKS042-7	1436	1370	977	1415	1350	876	1382	1316	816	1303	1237	740
42TKS048-7	1629	1474	1286	1534	1425	1203	1492	1386	1160	1420	1326	1116
42TKS060-7	1940	1854	1618	1853	1765	1488	1804	1712	1434	1711	1613	1357

42TKS Air Flow (L/S) – SI

ESP - Pa	25			50			75			100		
Unit Model	H	M	L	H	M	L	H	M	L	H	M	L
42TKS018-7	318	283	207	293	256	185	253	223	151	207	170	114
42TKS024-7	467	385	225	442	353	204	403	320	172	359	276	123
42TKS030-7	490	438	333	467	420	318	437	393	305	403	362	275
42TKS036-7	621	557	397	612	550	355	596	534	331	566	508	304
42TKS037-7	621	557	397	612	550	355	596	534	331	566	508	304
42TKS042-7	678	647	461	668	637	413	652	621	385	615	584	349
42TKS048-7	769	696	607	724	673	568	704	654	547	670	626	527
42TKS060-7	916	875	764	875	833	702	851	808	677	808	761	640

Legend:

CFM — Cubic feet per minute

L/S — Liter per second

in.wg — Inches of water gauge

Pa — Pascals

ESP — External static pressure

H — High speed, **M** — Medium speed, **L** — Low speed,

OPTIONS AND ACCESSORIES

Connection Side Option

Standard coil connection and electric box position is Right Hand facing air flow direction while the optional position is Left Hand facing the air flow for both coil connection and electric box. Customers can order this option directly from the factory. Also, units are designed to be field exchangeable if needed in the field.

Control Board Wire Extension

Standard wire length for control board is 15m. Optional extensions are available to enlarge the wire up to 30 m. If extension is required, please contact your local Carrier dealer.

GUIDE SPECIFICATIONS

COOLING ONLY DX INDOOR UNIT

SIZE: 1.5 TR TO 5.0 TR

SYSTEM DESCRIPTION

The direct expansion indoor units are designed for under ceiling installation, electrically controlled cooling. Unit shall be horizontal installation.

QUALITY ASSURANCE

- a) Units are designed / manufactured in accordance with ISO 9001:2015 facilities, International Standard for Quality Systems.
- b) Units are designed to conform to ASHRAE safety standard.
- c) Units are rated in accordance with ISO 13253 testing standard at T1 and T3 conditions.
- d) Insulation and adhesives are conforming to NFPA 90A requirements for flame spread and smoke generation.
- e) Units are run tested before packing.

DELIVERY STORAGE AND HANDLING

- a) Unit shall be stored and handled per manufacturer's recommendations.
- b) Lifting by crane requires either shipping top panel or spreader bars.
- c) Unit shall be stored or positioned in the upright position.

PRODUCT


- a) The units are factory assembled single piece cooling units.
- b) Unit cabinet shall be constructed of galvanized steel.
- c) Standard ducted unit's inner sections are insulated with NBR Elastomeric closed cell foam insulation, 50kg/m³ density.
- d) Drain pan is polyester powder coated on both sides & insulated outside.
- e) The unit fan wheel shall be directly connected to the motor. The fan wheel shall be dynamically balanced with double inlet forward curved type blower wheel.
- f) All coils are with 9.52mm seamless copper tubes and aluminum fins. Coil fins are mechanically bonded to copper pipes.
- g) The coil connections are sweat type LH/RH exchangeable.
- h) The unit fan motors are with permanently lubricated sleeve bearing and 3 speeds. The motor shall have internal overload protection and B class insulation.
- i) Unit shall have a wired control board with a built-in thermostat to be installed in the air-conditioned area and it shall have the following Features:
 - i. Control Modes – Cool, Dry, Fan, Auto Cool and Sleep mode.
 - ii. Compressor protections – 3 minutes restart protection.
 - iii. Indoor coil anti-freeze protection.
 - iv. Failure monitoring for room sensor and indoor coil sensor.
 - v. Non-volatile memory – keep system settings.
 - vi. Programmable On/Off timer.
 - vii. Random Restart Time Delay – to minimize voltage dip during compressor first cut in cycle upon power up for multiple units' operation.
- j) All electric parts are easily accessible for service.

INSTALLATION & OPERATIONS INSTRUCTIONS

SAFETY CONSIDERATIONS

The appliance is not to be used by persons (including children) with reduced physical, sensory or mental capabilities, or lack of experience and knowledge, unless they have been given supervision or instruction. Children should be supervised not to play with the appliance.

Improper installation, adjustment, alteration, service, maintenance or use can cause explosion, fire, electrical shock or other conditions which may cause personal injury or property damage. Consult a qualified installer; service agency must use factory-authorized kits or accessories when modifying this product. Refer to the individual instructions packaged with the kits or accessories when installing. Follow all the safety codes. Wear safety glasses and work gloves. Use quenching cloths for brazing operations and have a fire extinguisher available. Read these instructions thoroughly and follow all warnings or cautions attached to the unit. Consult local building codes for special requirements. In absence of local codes, it is recommended that the USA standard ANSI/NFPA 70, National Electrical Code (NEC), be followed.

It is important to recognize safety information. This is the safety-alert symbol . When you see this symbol on the unit and in instructions or manuals, are alert to the potential for personal injury. Understand the signal words **DANGER, WARNING, CAUTION, and NOTE**. These words are used with the safety-alert symbol. DANGER identifies the most serious hazards which will result in severe personal injury or death. WARNING signifies hazards which could result in personal injury or death. CAUTION is used to identify unsafe practices, which may result in minor personal injury or product and property damage. NOTE is used to highlight suggestions which will result in enhanced installation, reliability, or operation.

INSTALLATION SAFETY CONSIDERATIONS

After the unit has been received and when it is ready to be installed or reinstalled, it must be inspected for damage. If damage is detected upon receipt, immediately file a claim with the shipping company or repair. This machine must be installed in a location that is not accessible to the public and protected against access by non-authorized people. This machine must not be installed in an explosive atmosphere.

Do not remove the skid or the packaging until the unit is in its final position. The units can also be lifted with slings, using only the designated lifting points marked on the unit (labels on the chassis and a label with all unit handling instructions are attached to the unit). Use slings with the correct capacity, and always follow the lifting instructions on the certified drawings supplied for the unit.

Motors are permanently lubricated; use of any external lubricant (including WD40) is not allowed. For units without factory supplied control it is the full responsibility of the user to install proper controls matching the unit's design and capable to carry components current, control wiring should be strictly follow local/national electrical codes (i.e. using telephone wires or similar is prohibited). Safety is only guaranteed, if these instructions are carefully followed. If this is not the case, there is a risk of material deterioration and injuries to personnel.

WARRANTY

Warranty is based on the general terms and conditions of the manufacturer. Any modifications to the design and/or installation made without discussion with Carrier and without advance written agreement will result in the loss of the right to any warranty claims and any claim for injury to personnel as a result of these modifications.




WARNING - THE MANUFACTURER'S WARRANTY DOES NOT COVER ANY DAMAGE OR DEFECT TO THE AIR CONDITIONER CAUSED BY THE ATTACHMENT OR USE OF ANY COMPONENTS, ACCESSORIES, OR DEVICES (OTHER THAN THOSE AUTHORIZED BY THE MANUFACTURER) INTO, ONTO, OR IN CONJUNCTION WITH THE AIR CONDITIONER. YOU SHOULD BE AWARE THAT THE USE OF UNAUTHORIZED COMPONENTS, ACCESSORIES, OR DEVICES MAY ADVERSELY AFFECT THE OPERATION OF THE AIR CONDITIONER AND MAY ALSO ENDANGER LIFE AND PROPERTY. THE MANUFACTURER DISCLAIMS ANY RESPONSIBILITY FOR SUCH LOSS OR INJURY RESULTING FROM THE USE OF SUCH UNAUTHORIZED COMPONENTS, ACCESSORIES, OR DEVICES.

RECEIVING

42TKS fan coil units are shipped individually packed in carton boxes. When cartons are individually off loaded from the truck, do not roll, or throw, or drop the carton to avoid damage to the contents. Store boxes upright as the symbols on the boxes indicated. Do not stack units more than 8 units high for sizes 018-024 and 6 units high for sizes 030 - 060.

UNPACKING INSTRUCTIONS


1. Prepare unit for unpacking
2. Remove two (2) pieces, of plastic straps
3. Open carton flaps
4. Lift unit assembly carefully out of carton box

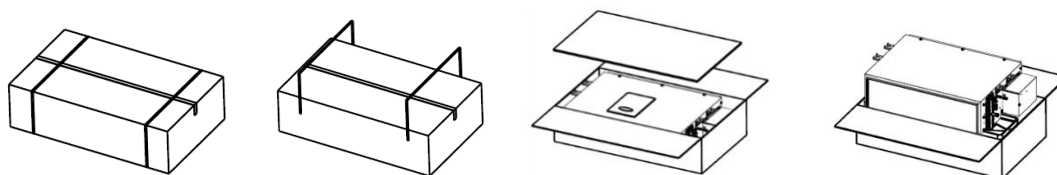

Unpacking Instructions

PACKING INSTRUCTIONS

1. Lift unit assembly and carefully place into the carton box.
2. Place the IOM
3. Close carton flaps and seal with tape along flap side, wrap with two (2) pieces of plastic straps around the box

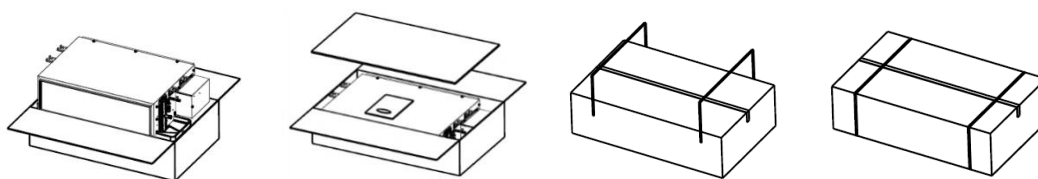

Packing Instructions

INSPECTION

Check the shipment against shipping list, remove unit from the carton and take off protective covering. If the unit has been damaged, file claim with transportation company and notify Carrier immediately.

PROTECTION

Protect unit from damage caused by job site debris. Do not allow dust, debris and water to get into the unit. This will damage unit's component and unit's performance will be affected.

PRELIMINARY CHECK

Following is a checklist which should be checked before the installation is started. The installer should be familiar with each of the following requirements before the actual installation.

1. Space requirements and clearances.
2. Ceiling or mounting strength.
3. Piping connections.
4. Condensate drains connection.
5. Power supply and wiring.
6. Air duct connections.
7. The condensing unit model number is the recommended by the factory (as per "Combination Ratings and Matrix").

PREPARE JOBSITE FOR UNIT INSTALLATION

To save time and to reduce the possibility of costly errors, set up a complete sample installation in a typical room at jobsite. Check all critical dimensions such as pipe, wire, and duct connection requirements. Refer to job drawings and product dimension drawings as required. Instruct all trades in their part of the installation.

IDENTIFY AND PREPARE UNITS

Be sure power requirements match available power source. Refer to unit nameplate and wiring diagram.

1. Check all tags on unit to determine if shipping screws are to be removed. Remove screws as directed.
2. Rotate the fan wheel by hand to ensure that the fan is unrestricted and can rotate freely. Check for shipping damage and fan obstructions.

UNIT CONFIGURATION

The piping connections drain pan outlet and control box are located on the right side of the unit facing the airflow direction as factory standard as shown in the unit picture. Left hand side connection is a factory option. However, the connections side can be relocated at site.

RIGGING AND UNPACKING

Unit should not be removed from carton until reaching final location to avoid damage. Inspect unit for shipping damage and file claim with transportation company if necessary, check nameplate voltage against available power supply. For special installation, consult local building and electrical codes.


INSTALLATION

PLACING UNIT IN POSITION

1. Select the unit location. Allow adequate space for free air circulation, service clearances, piping and electrical connections, and any necessary ductwork.
2. Be sure that the ceiling can support the weight of the unit. See "Physical Data" for nominal unit weight.
3. Move unit into position. Ensure unit is level or pitched towards drain to ensure proper drainage and operation.
4. Mounting units to the ceiling - When unit is lifted, access to the mounting holes is on the top panel of the unit. Hanger rods, fasteners, and other required hardware must be field supplied.

PIPING CONNECTIONS

Qualified personnel in accordance with local and national codes must perform all piping connections. Refer to "Physical Data" for piping connections. NOTE: It is important to have a common understanding of which side of the unit is the right-hand side and which is the left-hand side. When facing the supply air outlet from the front of the unit (air blowing in your face), your right hand will be on the right side of the unit and your left hand will be on the left side of the unit. Use the condensing unit manufacturer's recommended line sizes and requirements; see "Combination Ratings and Matrix". **Suction line must be insulated for correct operation.** Use refrigerant-grade copper lines only. The unit is not applied as a heat pump.

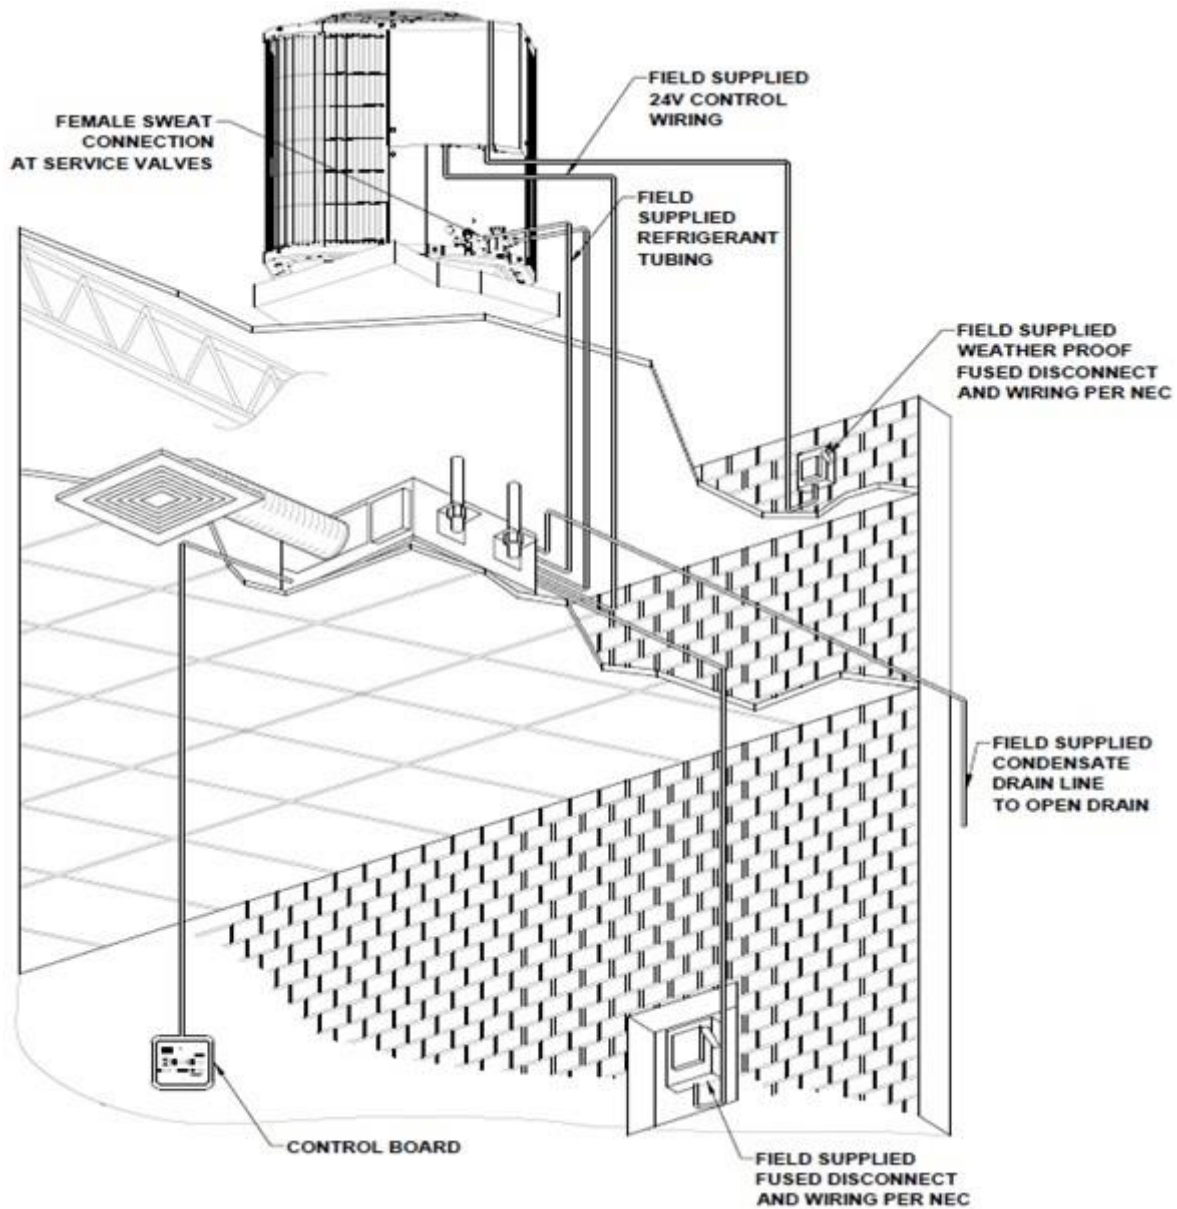

Typical Wiring & Piping Connections

NOTES:

1. All piping must follow standard refrigerant piping techniques.
2. All wiring must comply with the applicable local and national electric codes.
3. Wiring and piping shown are general points-of-connection guides only not intended for a special installation.
4. Insulate condensate line if run above a conditioned space.
5. The control board kit is factory supplied; no thermostat required.
6. The wall mounted wired room controller could control all system functions without wireless remote control.
7. Standard wire length for the control board is 7.5 m. If extension is required, please consult Carrier.

TEST AND INSULATE

When all joints are complete, perform hydrostatic test for leaks. Vent all coils at this time. Check interior unit piping for signs of leakage from shipping damage or mishandling. If leaks are found, notify a Carrier representative before initiating any repairs. Release trapped air from system (refer to Final Preparations section).

ELECTRICAL CONNECTIONS

Refer to unit nameplate for required supply voltage, fan amperage and required circuit amp. Refer to unit wire diagram for unit and field wiring; see "Typical Wiring & Piping Connections", "Typical Wiring Schematic" and "Electrical Data". Make sure all electrical connections are in accordance with unit wiring diagram and all applicable codes. The fan motor(s) should never be controlled by any wiring or device other than the factory-supplied control board. All field wiring must be in accordance with governing codes and ordinances. Any modification of unit wiring without factory authorization will invalidate all factory warranties and nullify any agency listings.

- Select proper wall location to fix display pad
- Connect communication cable end to its location in the PCB as shown in the wiring diagram.

Follow local/national wiring regulations and code for all wiring to the unit, in absence of local codes use power supply wires sizes which are at least 1.25 times the unit's full load current and circuit breaker size 2 - 2.25 times the unit's full load current.

DUCT CONNECTIONS

Install all ductwork to and from unit in accordance with all applicable codes. Duct construction must allow unit to operate within duct external static pressure limits as shown on job submittals. Units designed to operate with ductwork may be damaged if operated without intended ductwork attached. Units provided with outside air should have some method of low-temperature protection to prevent freeze-up. Insulate ductwork as required. Use flexible connections to minimize duct-to-unit alignment problems and noise transmission where specified. Set unit markings for minimum clearance to combustible materials and first 3 ft of ductwork. Install ductwork, accessory grilles and plenums so that they do not restrict access to filter. Cut openings for supply-air and return-air grilles. Be careful not to cut wires, piping or structural supports.

Caution: Prevent dust and debris from settling in unit. If wall finish or color is to be spray applied, cover all openings to prevent spray from entering unit. Unit efficiency will be reduced.

FINAL PREPARATIONS

1. Turn off power to the unit (open unit electrical disconnect).
2. Install the wired control panel kit and perform any other final wiring as applicable, see the controller for ducted fan coil units' section.
3. Clean dirt, dust, and other construction debris from unit interior. Be sure to check fan wheel and housing.
4. Rotate fan wheel by hand to be sure it is free and does not rub housing. Check that wing nuts securing fan assembly to fan deck are tight.
5. Be sure drain line is properly and securely positioned and that the line is clear. Pour water into drain to check operation.

Important: Do not start-up or operate unit without filter. Be sure filter and unit interior are clean.

START-UP

42TKS unit is designed to operate in hot and humid conditions without condensation problem because of the rubber insulated drain pan. Refer to the "Mandatory Startup Checklist and Record" for startup procedure.

SERVICE

Warning: Failure to follow this caution may result in equipment damage. Motors are permanently lubricated; Please do not use any external lubricant.

CLEAN COIL

1. Be sure electrical service switch is open, locked, and tagged while working on unit.
2. Coil can be cleaned by removing filter and bottom panel and brush between coil fins with stiff wire brush. Follow-up by cleaning with vacuum cleaner. If coil is cleaned with air hose and nozzle, take care not to drive dirt and dust into other components.

CHECK DRAIN

Lock open and tag unit electrical service switch. Check drain pan drain line and trap at start of each cooling season. A standard type pipe cleaner for 3/4-in. ID pipe can be used to ensure that pipe is clear of obstruction so that condensate is carried away.

CLEAN FAN WHEEL

Lock open and tag unit electrical service switch. For access to fan assembly, remove supply air duct and bottom panel. Use a stiff brush or vacuum to remove dirt and debris from scroll. Wipe all fan surfaces with a damp cloth.

CLEAN OR REPLACE AIR FILTERS

Lock open and tag unit electrical service switch. At the start of each cooling season and after each month of operation (depending on operating conditions) replace throwaway filter or clean permanent filter.

THROWAWAY FILTER

Replace filter with a good quality filter of the size shown in "Physical Data". Do not attempt to clean and reuse disposable filters.

PERMANENT FILTER

1. Tap on solid surface to dislodge heavy particles.
2. Wash in hot water.
3. Set filter on end so that water drains out through slots in frame. Allow filter to dry thoroughly. See Fig.8 for filter access.

UNIT CONTROLLER

1.1 Functions:

- Modes: Cool, Dry and Fan.
- Fan Speed: High, Medium, Low.
- Sleep Mode, programmable On/Off timer.
- Compressor protections: Compressor 3-minute restart protection, Indoor coil anti-freeze, Room Sensor and indoor coil sensor failure monitoring.
- Random restart to minimize voltage dip during compressor first cut in cycle upon power up.

1.2 Hardware Setting: A 2-way DIP switch is used to configure:


DIP Switch	ON	OFF
SW1	Cool	OFF
SW2	-	DX system

1.3 Error Code: The corresponding error code will be shown one after another, in-case if multiple faults.





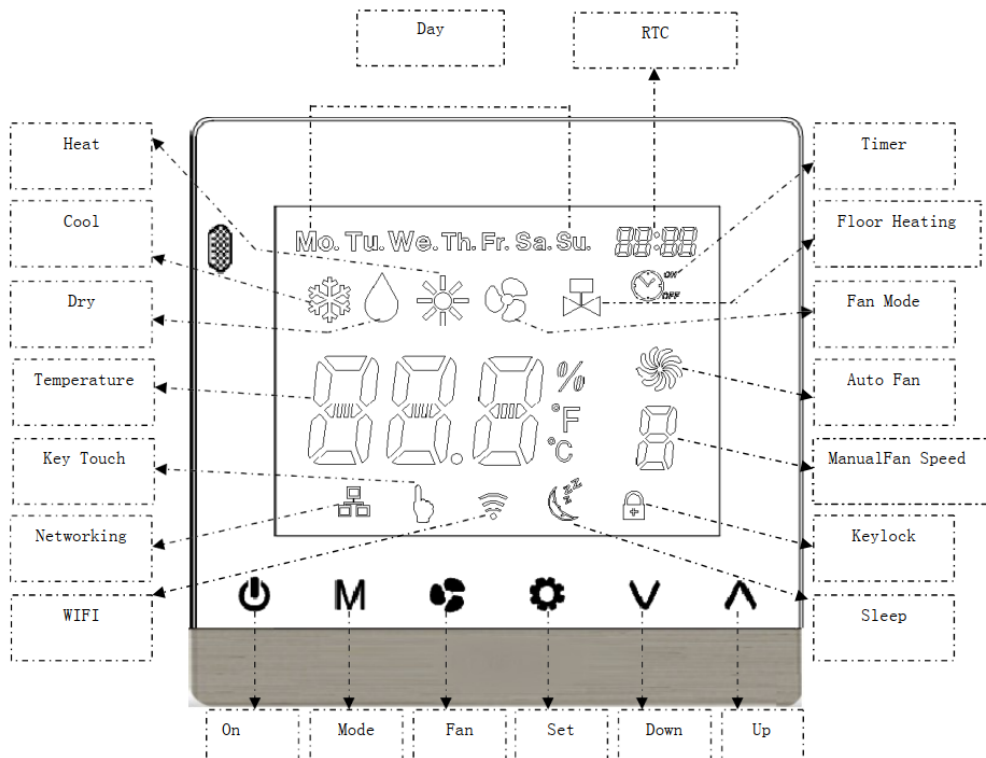

Error code	E1	E2	E4
Fault	Room Sensor	Indoor coil sensor	Compressor






























1.4 Description:

1) LCD Screen



2) Key Function:

Icon						
Function	On / Off	Mode	Fan	Set	Down	Up



- 3) **System On/Off:** Press  to turn on or off the unit.
- 4) **Mode:** Press  key to change operating mode as follow:
Cool Only Model: Cool – Dry – Fan
- 5) **Fan Speed:** Press  key to select: Auto – High – Medium – Low which is indicated as A-3-2-1 on fan speed digital setting. Fan key is invalid in Dry mode.
- 6) **Temperature Setting:** Press  or  key to adjust set temperature. Temperature setting is 20°C to 30°C or 68°F to 85°F. Temp keys are invalid in Fan mode. Press  and  key together to switch between Celsius to Fahrenheit setting.
- 7) **Sleep:** Hold on  key to toggle sleep mode setting. Sleep key is invalid in Fan or Dry mode. Sleep mode will automatically cancel after 8 hours.
- 8) **RTC:** Press  key to enter RTC setting. Press  or  key to adjust hour or minute. Press  key to select hour, minute or day of week. Press  key to confirm and exit.
- 9) **Timer On or Off:** Press  and  keys to enter timer setting. Press  key to change items as follow: day of week, timer on enable or disable, timer on hour, timer on minute, timer off enable or disable, timer off hour, timer off minute. (When hour or minute being selected, it will flash).
Press  or  key to adjust the time for timer on or off being selected. Press  key to confirm and exit. Press  key to exit and ignore setting. It will exit and ignore setting automatically 6 sec after last key press. If timer ON is programmed ON symbol lights on. If timer off is programmed OFF symbol lights on. If ON or OFF timer is available for current day of week, Timer symbol lights on.
- 10) **Cancel Timer:** Hold  key for 3 seconds to cancel all timer settings.
- 11) **Key Lock:** In main menu, hold on  and  key to lock or unlock the keys. In key lock mode only  key is invalid.
- 12) **Information Browsing:** Press   keys for 3 sec to browse the following temperature.
Press  or  key to browse the temperature. Press  key to exit.

RTC Display Zone	Temperature Display Zone
A1	Room Temperature
A2	Indoor Coil Temperature

13) Error Code Display: Should there be any system error, it will be shown on temperature display zone. If multiple faults happen at the same time, the corresponding error code will be shown one after another.

Fault	Error Code
Room sensor fault	E1
Indoor coil sensor fault	E2
Compressor fault	E4
Communication fault	E15

14) Edit System Parameter: Press  and  key enter password menu. Key in password “1111” by  or  key to change selected digit.

Press  key to select the password digit. Press  key to verify the password. If password entry is correct, RTC display area will show the submenu number.

Press  or  key to select the sub menu, press  or  key to adjust the value selected sub menu.

Press  key to confirm and exit. Press  key to exit and ignore setting.

Submenu	Description	Range	Options
A1	Temp display	1 ~ 2	1: Disable Room Temp Display 2: Enable Room Temp Display
A2	Cool mode fan control function	1 ~ 2	1: Compressor off; Fan On 2: Compressor off; Fan off

TROUBLESHOOTING

Symptom	Possible Causes	Remedy
Unit will not run	Power off or loose electrical connection	Check for correct voltage at contactor in condensing unit.
	Thermostat out of calibration-set too high	Reset.
	Defective contactor	Check for control voltage at contactor coil - replace if contacts are open.
	Blown fuses or Transformer defective	Replace fuses / Check wiring-replace transformer.
	High pressure control open (if provided)	Reset-also see high head pressure remedy-The high-pressure control opens at 650PSIG
Outdoor fan runs, compressor doesn't	Run or start capacitor defective	Replace
	Start relay defective	Replace
	Loose connection	Check for correct voltage at compressor check & tighten all connections
	Compressor stuck, grounded or opens motor winding.	Wait at least 2 hours for overload to reset. Open internal overload. If still open, replace the compressor.
	Low voltage condition	Add start kit components
Insufficient cooling	Improperly sized unit	Recalculate load
	Improper indoor airflow	Check, remove obstructions - clean filters if necessary
	Incorrect refrigerant charge	Charge per procedure attached to unit service panel
	Air, non-condensable or moisture in system	Recover refrigerant, evacuate & recharge, add filler drier.
Compressor short cycles	Incorrect voltage	At compressor terminals, voltage must be $\pm 10\%$ of nameplate marking when unit is operating.
	Defective overload protector	Replace, if external - check for correct voltage
	Refrigerant undercharge	Add refrigerant
Indoor unit sweats	Low indoor airflow	Increase speed of blower or reduce restriction -clean air filters.
	Improper indoor unit installation	Assure condensate is draining properly & that insulation is dry.
High head-Low vapor pressures	Restriction in liquid line, expansion device or filter drier	Remove or replace defective component.
High head-high or normal vapor pressure - Cooling mode	Dirty outdoor coil	Clean coil
	Refrigerant overcharge	Correct system charge
	Outdoor fan not running	Repair or replace.
	Air or non-condensable in system	Recover refrigerant, evacuate & recharge
High head - high or normal vapor pressure - Heating mode	Low air flow - indoor coil	Check filters - correct to speed
	Refrigerant overcharge	Check system charge
	Air or non-condensable in system	Recover refrigerant, evacuate & charge
	Dirty indoor coil	Check filter - clean coil
Low head-high vapor pressures	Defective Compressor valves	Replace compressor
Low vapor - cool compressor - iced indoor coil	Low indoor airflow	Increase speed. of blower or reduce restriction
	Moisture in system	clean air filter iced indoor coil
High vapor pressure	Excessive load	Recheck load calculation
	Defective compressor	Replace
Fluctuating head & vapor pressures	Air or non-condensable in system	Recover refrigerant, evacuate & recharge
Gurgle or pulsing noise at expansion	Air or non-condensable in system	Recover refrigerant, evacuate & recharge

START-UP CHECK LIST

MANDATORY START-UP CHECK LIST AND RECORD

IMPORTANT!

This page is a mandatory checklist & record – the check to be executed and data to be recorded for future reference in case of failure.

A copy of this checklist data must be submitted to Carrier representative. Completion of this checklist is a must for any field claim, no field support will be provided for incomplete or blank checklists.

Preliminary Information

Outdoor Model Number		Outdoor Serial Number	
Indoor Model Number		Indoor Serial Number	
Startup Date		Technician Name	
Customer Name/Address		Project Name	
Additional Accessories			

Pre-Start-Up Checklist	Yes	No	NA
Outdoor Unit			
Is there any shipping damage?			
If the unit is damaged, please specify where:			
Will this damage prevent the unit start-up?			
Check power supply to see if it matches the unit data plate?			
Has the ground wire been properly connected?			
Are the circuit protection matched with the unit size and installed properly?			
Are the power wire gauge matched with the unit size and installed properly?			
Piping			
Are both refrigerant lines flushed / cleaned, connected to service valve sets and properly tightened?			
Are all the service valves open and back seated?			
Is the Stem Valves Installed and snug?			
Have all the refrigerant connections and piping joints checked for leaks and vacuum test conducted to 500 microns?			
Indoor Fan Coil Unit Piping			
Check accurate device size is matched and installed in fan coil unit? (If Applicable)			
Are the refrigerant connections properly connected and have been checked for leakages?			
Is condensate line connected?			
Is the condensate line free from obstacle and drains freely?			
Controls			
Are control power lines connected to their control power terminal block?			
Are terminal snug in the housing?			
Are control power lines and control cables routed separately (Not in the same conduit and not in same multi-conductor cable)?			
Are control wires connected to the same circuit as associated refrigerant lines?			
Check to make sure the subbase mounting to wall is secure. (Don't apply excessive force to mounting screw)			

Fan System			
Does fan rotate freely?			
Are air filters in place and clean?			
Indoor Power Supply			
Does the power supply match the fan coil unit data plate?			
Is ground wire connected?			
Start-Up Checklist	Yes	No	NA
Check Indoor Fan Operation Under Ceiling Fan Coil Units			
Select fan mode, then initiate test sequence. Does the fan motor start at low speed, then shift to medium then to high?			
Start System Operation at the Fan Coil Unit			
Select cooling mode and adjust set point, it must be below current room temperature then observe unit operation.			
Does compressor start (After Initial Time Delay) and Run?			
Does outdoor fan run properly?			
After at least 15 minutes of running time, record all the information below:			
Outdoor Unit		Fan Coil Unit	
Unit Amps(L1/L2/L3)		Indoor Entering Air DB (Dry Bulb) Temp	
Voltage (L1/L2/L3)		Indoor Leaving Air DB (Dry Bulb) Temp	
Vapor Line Pressure		Indoor Entering Air WB (Wet Bulb) Temp	
Vapor Line Temp		Indoor Leaving Air WB (Wet Bulb) Temp	
Liquid Line Temp		Technician Name, Signature and Date:	
Entering Outdoor Air Temp			
Leaving Outdoor Air Temp			

Manufacturer reserves the right to change, at any time, specifications and designs without notice and without obligations.